

NPDES Permit No. IL0021989

Notice No. CWB:24031101

Public Notice Beginning Date: August 04, 2024

Public Notice Ending Date: September 03, 2024

National Pollutant Discharge Elimination System (NPDES)
Permit Program

PUBLIC NOTICE/FACT SHEET

of
Draft Reissued NPDES Permit to Discharge into Waters of the State

Public Notice/Fact Sheet Issued By:

Illinois EPA
Division of Water Pollution Control
Permit Section
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276
217/782-0610

Name and Address of Permittee:

Sangamon County Water Reclamation District
3000 North 8th Street Road
Springfield, Illinois 62707

Name and Address of Facility:

Spring Creek STP
3000 North 8th Street Road
Springfield, Illinois 62707
(Sangamon County)

The Illinois Environmental Protection Agency (IEPA) has made a tentative determination to issue a NPDES Permit to discharge into the waters of the state and has prepared a draft Permit and associated fact sheet for the above named Permittee. The Public Notice period will begin and end on the dates indicated in the heading of this Public Notice/Fact Sheet. All comments on the draft Permit and requests for hearing must be received by the IEPA by U.S. Mail, carrier mail or hand delivered by the Public Notice Ending Date. Interested persons are invited to submit written comments on the draft Permit to the IEPA at the above address. Commentors shall provide his or her name and address and the nature of the issues proposed to be raised and the evidence proposed to be presented with regards to those issues. Commentors may include a request for public hearing. Persons submitting comments and/or requests for public hearing shall also send a copy of such comments or requests to the Permit applicant. The NPDES Permit and notice numbers must appear on each comment page.

The application, engineer's review notes including load limit calculations, Public Notice/Fact Sheet, draft Permit, comments received, and other documents are available for inspection and may be copied at the IEPA between 9:30 a.m. and 3:30 p.m. Monday through Friday when scheduled by the interested person.

If written comments or requests indicate a significant degree of public interest in the draft Permit, the permitting authority may, at its discretion, hold a public hearing. Public notice will be given 45 days before any public hearing. Response to comments will be provided when the final Permit is issued. For further information, please call Corey Branson at 217/782-0610.

The following water quality and effluent standards and limitations were applied to the discharge:

Title 35: Environmental Protection, Subtitle C: Water Pollution, Chapter I: Pollution Control Board and the Clean Water Act were applied in determining the applicable standards, limitations and conditions contained in the draft Permit.

The applicant is engaged in treating domestic wastewater for the City of Springfield, City of Leland Grove, Village of Jerome, Village of Chatham, Village of Sherman, Village of Grandview and unincorporated areas of Sangamon County.

The length of the Permit is approximately 5 years.

The main discharge number is 007. The seven day once in ten year low flow (7Q10) of the receiving stream, Sangamon River is 54.8 cfs.

The design average flow (DAF) for the facility is 32.0 million gallons per day (MGD) and the design maximum flow (DMF) for the facility is 80.0 MGD. Treatment consists of bar screens, grit chambers, primary clarifiers, biological nutrient removal activated sludge process, secondary clarifiers, ultra-violet disinfection, post aeration. Biosolids are treated using: anaerobic digestion and sludge thickening. Combined sewer overflows from outfall 013 are treated using: primary clarifiers, polishing pond and chlorination.

This treatment works has an approved pretreatment program. There are 1 noncategorical SIUs and 2 CIUs.

This Reissued Permit does not increase the facility's DAF, DMF, concentration limits, and/or load limits.

The facility is located in or near a potential Environmental Justice area pursuant to Illinois EPA's Environmental Justice Public Participation Policy. More information concerning Environmental Justice may be found at the following IEPA webpage: <https://epa.illinois.gov/topics/environmental-justice.html> or by contacting Chris Pressnall, EJ Officer, at 217/524-1284.

Application is made for the existing discharge(s) which is located in Sangamon County, Illinois. The following information identifies the discharge point, receiving stream and stream classifications:

<u>Discharge Number</u>	<u>Receiving Stream</u>	<u>Latitude</u>	<u>Longitude</u>	<u>Stream Classification</u>	<u>Integrity Rating</u>
001 Oak Knolls CSO	Spring Creek	39° 48' 54" North	89° 41' 58" West	General Use	C
002 Amos Branch CSO	Town Branch	39° 48' 39" North	89° 40' 36" West	General Use	Not Rated
003 Town Branch CSO	Town Branch	39° 49' 17" North	89° 41' 05" West	General Use	Not Rated
005 Oak Ridge CSO	Spring Creek	39° 49' 34" North	89° 39' 38" West	General Use	C
006 State Fairgrounds CSO	Spring Creek	39° 50' 08" North	89° 38' 59" West	General Use	C
007 STP Outfall	Sangamon River	39° 51' 37" North	89° 38' 29" West	General Use	C
013 Treated CSO	Spring Creek	39° 50' 37" North	89° 39' 08" West	General Use	C

This permit authorizes discharge from 6 CSOs in accordance with 35 Ill. Adm. Code 306.305

To assist you further in identifying the location of the discharge(s) please see the map on page 4 of the Public Notice Fact Sheet.

The Spring Creek STP discharges via outfall 007 to the Sangamon River, Waterbody Segment, IL_E-04. This segment is listed on the 2020/2022 Illinois Integrated Water Quality Report and Section 303(d) List as impaired for fish consumption use with potential causes given as polychlorinated biphenyls. Aesthetic quality and aquatic life uses are fully supported. Primary contact use has not been assessed. Segment IL_E-24 is 15.78 stream miles in length.

Segment IL_E-24 is the next segment of the Sangamon River. The Sangamon River, Waterbody Segment, IL_E-24, is listed on the 2020/2022 Illinois Integrated Water Quality Report and Section 303(d) List as impaired for fish consumption use with potential causes given as polychlorinated biphenyls, and as impaired for primary contact use with potential causes given as fecal coliform. Aesthetic quality and aquatic life uses are fully supported. Segment IL_E-24 is 23.11 stream miles in length.

Segment IL_E-25 is the next segment of the Sangamon River. The Sangamon River, Waterbody Segment, IL_E-25, is listed on the 2020/2022 Illinois Integrated Water Quality Report and Section 303(d) List as impaired for fish consumption use with potential causes given as polychlorinated biphenyls, and as impaired for primary contact use with potential causes given as fecal coliform. Aesthetic quality and aquatic life uses are fully supported. Segment IL_E-25 is 36.42 stream miles in length.

The Spring Creek STP effluent travels a total of 75.31 miles in the stream continuum before it flows into the Illinois River. There is no algae impairment noted in the 303(d) List nor is there any impairment due to a cause of dissolved oxygen, which is indicative of an algae impairment, anywhere in this downstream continuum. There is no evidence to imply that phosphorus from Spring Creek STP is causing any impairment prohibited by the narrative water quality standard.

The discharge(s) from the facility is proposed to be monitored and limited at all times as follows:

Discharge Number(s) and Name(s): 007 STP Outfall

Load limits computed based on a design average flow (DAF) of 32.0 MGD (design maximum flow (DMF) of 80.0 MGD).

The effluent of the above discharge(s) shall be monitored and limited at all times as follows:

Parameter	LOAD LIMITS lbs/day			CONCENTRATION			Regulation
	Monthly Average	Weekly Average	Daily Maximum	Monthly Average	Weekly Average	Daily Maximum	
CBOD ₅ **	2669 (6672)		5338 (13344)	10		20	35 IAC 304.120 40 CFR 133.102
Suspended Solids**	3203 (8006)		6405 (16013)	12		24	35 IAC 304.120 40 CFR 133.102
pH	Shall be in the range of 6 to 9 Standard Units						35 IAC 304.125
Fecal Coliform	Daily Maximum shall not exceed 400 per 100 mL (May through October)						35 IAC 304.121
Chlorine Residual						0.038	35 IAC 302.208
Ammonia Nitrogen: (as N)							35 IAC 355 and 35 IAC 302
March-May/Sept.-Oct.	400 (1001)	1014 (2535)	1041 (2602)	1.5	3.8	3.9	
June-August	320 (801)		721 (1801)	1.2		2.7	
Nov.-Feb.	1068 (2669)		1201 (3002)	4.0		4.5	
Total Nitrogen (as N)						Monitor Only	35 IAC 309.146
Boron						Monitor Only	35 IAC 309.146
Cyanide (available)						Monitor Only	35 IAC 309.146
Total Phosphorus (as P)	267 (667)			1.0			35 IAC 304.123
PFAS***			Monitor Only			Monitor Only	35 IAC 309.146
				Monthly Avg. not less than	Weekly Avg. not less than	Daily Minimum	
Dissolved Oxygen****							
March-July				N/A	6.0	5.0	35 IAC 302.206
August-February				5.0	4.0	3.5	

*Load Limits are calculated by using the formula: $8.34 \times (\text{Design Average and/or Maximum Flow in MGD}) \times (\text{Applicable Concentration in mg/L})$.

**BOD₅ and Suspended Solids (85% removal required): In accordance with 40 CFR 133, the 30-day average percent removal shall not be less than 85 percent.

***To address Per- and polyfluoroalkyl substance (PFAS) under the NPDES permit program the Illinois Environmental Protection Agency (IEPA), Bureau of Water, Permit Section has implemented a PFAS Reduction Initiative. Under this initiative, it has been determined that those Publicly Owned Treatment Works who are classified as a major discharger by USEPA, and because of the type and variety of industries that discharge to the sewer system, there is the potential for the publicly owned treatment works to receive wastewater contaminated by PFAS. To help eliminate and/or control the amount of PFAS being discharged to the sewer system, the permittee will be required to monitor for PFAS compounds and to require Best Management Practices (BMP's) be developed by specific industrial facilities. Monitoring will be done at the wastewater treatment plants influent, effluent and biosolids. The permit will also require BMP's be developed for those industrial facilities who have been identified by USEPA as having the potential to use and/or discharge PFAS compounds. Monitoring for PFAS has been added to the effluent limitations, monitoring, and reporting page(s) for outfall 007 and Special Conditions 23 and 24 have been added to the permit as well.

****Dissolved Oxygen monitoring shall not be required when the Sangamon River stage exceeds the 25-year flood elevation of 525.11 feet based on the NGVD29 datum.

Discharge Number(s) and Name(s): 013 Treated Combined Sewage Outfall (Flows from 55,555 gpm to 147,917 gpm)


CONCENTRATION

<u>Parameter</u>	<u>LIMITS (mg/L)</u>	<u>Regulation</u>
	<u>Daily Maximum</u>	
Fecal Coliform	Daily Maximum Shall Not Exceed 400 per 100 mL	35 IAC 304.121
BOD ₅	Monitor Only	35 IAC 309.146
Suspended Solids	Monitor Only	35 IAC 309.146
pH	Shall be in the range of 6 to 9 Standard Units	
Chlorine Residual	0.75	35 IAC 302.208
Ammonia Nitrogen (as N)	Monitor Only	35 IAC 309.146
Total Phosphorus (as P)	Monitor Only	35 IAC 309.146

This draft Permit also contains the following requirements as special conditions:

1. Reopening of this Permit to include different final effluent limitations.
2. Operation of the facility by or under the supervision of a certified operator.
3. Submission of the operational data in a specified form and at a required frequency at any time during the effective term of this Permit.
4. More frequent monitoring requirement without Public Notice in the event of operational, maintenance or other problems resulting in possible effluent deterioration.
5. Prohibition against causing or contributing to violations of water quality standards.
6. Recording the monitoring results on Discharge Monitoring Report Forms using one such form for each outfall each month and submitting the forms to IEPA each month.
7. The provisions of 40 CFR Section 122.41(m) & (n) are incorporated herein by reference.
8. Effluent sampling point location.
9. Seasonal fecal coliform limits.
10. The Permittee implements and administers an industrial pretreatment program pursuant to 40 CFR §403.
11. Submission of annual fiscal data.
12. A requirement for biomonitoring of the effluent.
13. Submission of semi annual reports indicating the quantities of sludge generated and disposed.
14. An authorization of combined sewer and treatment plant discharges.
15. Reopening of this Permit to include revised effluent limitations based on a Total Maximum Daily Load (TMDL) or other water quality study.
16. Reissued CMOM.
17. Permittee shall reuse 1,800,000 gallons a month within the facility.
18. Total Nitrogen Monitoring.
19. Burden Reduction.
20. NARP Permit Conditions – Timelines and exceptions.
21. NARP Risk of Eutrophication.
22. Mixing for Ammonia not granted for this discharge.
23. PFAS Testing and Reporting.
24. PFAS Minimization Program.
25. Additional Monitoring Requirements for Cyanide.

Spring Creek STP

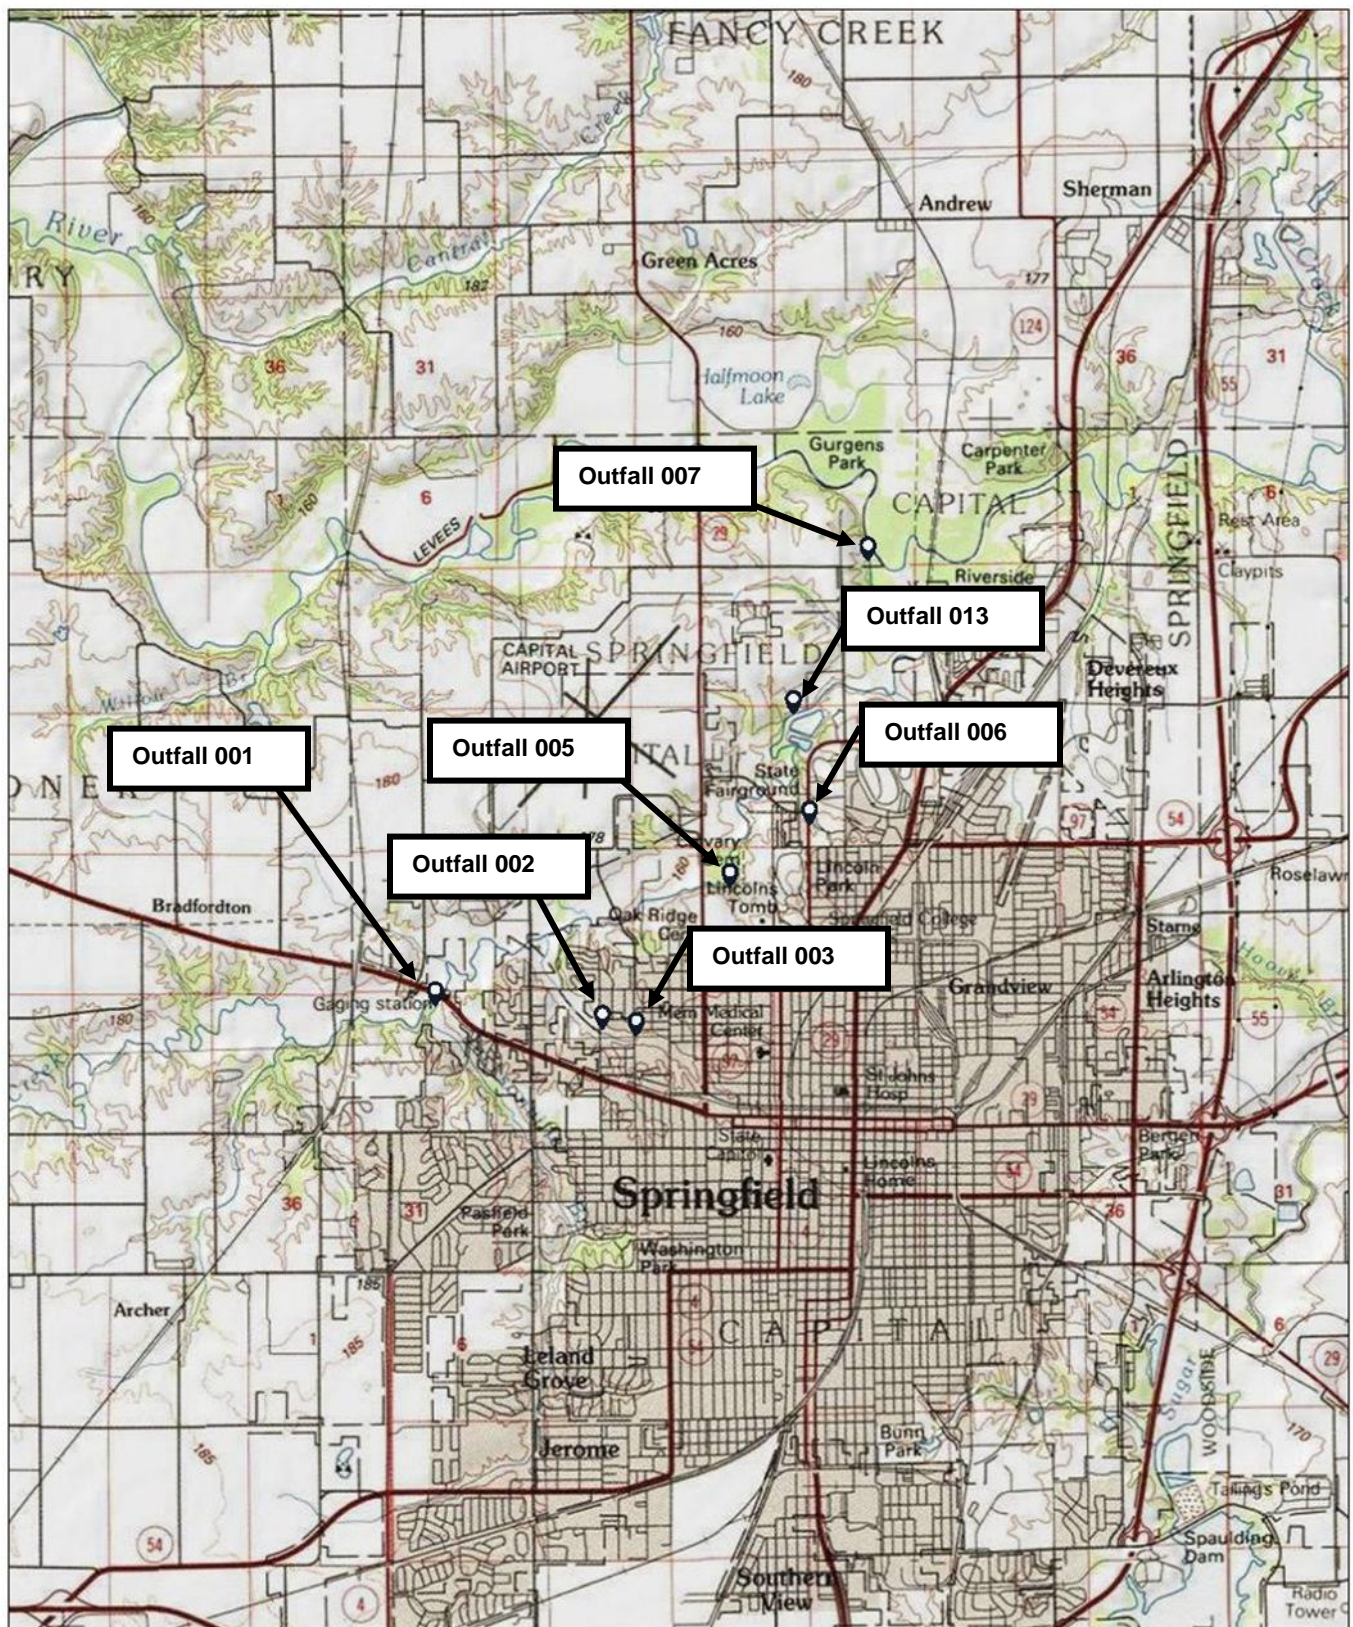

4/22/2024

1:72,776



NPDES Permit No. IL0021989

Illinois Environmental Protection Agency

Division of Water Pollution Control

1021 North Grand Avenue East

Post Office Box 19276

Springfield, Illinois 62794-9276

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM

Reissued (NPDES) Permit

Expiration Date:

Issue Date:

Effective Date:

Name and Address of Permittee:

Sangamon County Water Reclamation District
3000 North 8th Street Road
Springfield, Illinois 62707

Facility Name and Address:

Spring Creek STP
3000 North 8th Street Road
Springfield, Illinois 62707
(Sangamon County)

Receiving Waters: Sangamon River

In compliance with the provisions of the Illinois Environmental Protection Act, Title 35 of the Ill. Adm. Code, Subtitle C, Chapter I, and the Clean Water Act (CWA), the above-named Permittee is hereby authorized to discharge at the above location to the above-named receiving stream in accordance with the Effluent Limitations, Monitoring, and Reporting requirements; Special Conditions and Attachment H Standard Conditions attached herein.

Permittee is not authorized to discharge after the above expiration date. In order to receive authorization to discharge beyond the expiration date, the Permittee shall submit the proper application as required by the Illinois Environmental Protection Agency (IEPA) not later than 180 days prior to the expiration date.

Darin E. LeCrone, P.E.
Manager, Permit Section
Division of Water Pollution Control

BDF:CWB:24031101

NPDES Permit No. IL0021989
Effluent Limitations, Monitoring, and Reporting
 FINAL

Discharge Number(s) and Name(s): 007 STP Outfall

Load limits computed based on a design average flow (DAF) of 32.0 MGD (design maximum flow (DMF) of 80.0 MGD).

From the effective date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

<u>Parameter</u>	<u>LOAD LIMITS lbs/day</u> <u>DAF (DMF)*</u>			<u>CONCENTRATION</u> <u>LIMITS mg/L</u>			<u>Sample</u> <u>Frequency</u>	<u>Sample</u> <u>Type</u>
	<u>Monthly</u> <u>Average</u>	<u>Weekly</u> <u>Average</u>	<u>Daily</u> <u>Maximum</u>	<u>Monthly</u> <u>Average</u>	<u>Weekly</u> <u>Average</u>	<u>Daily</u> <u>Maximum</u>		
Flow (MGD)							Continuous	
CBOD ₅ **' ***	2669 (6672)		5338 (13344)	10		20	2 Days/Week	Composite
Suspended Solids***	3203 (8006)		6405 (16013)	12		24	2 Days/Week	Composite
pH	Shall be in the range of 6 to 9 Standard Units						2 Days/Week	Grab
Fecal Coliform****	Daily Maximum shall not exceed 400 per 100 mL (May through October)						5 Days/Week	Grab
Chlorine Residual						0.038	***	Grab
Ammonia Nitrogen: (as N)								
March-May/Sept.-Oct.	400 (1001)	1014 (2535)	1041 (2602)	1.5	3.8	3.9	2 Days/Week	Composite
June-August	320 (801)		721 (1801)	1.2		2.7	2 Days/Week	Composite
Nov.-Feb.	1068 (2669)		1201 (3002)	4.0		4.5	2 Days/Week	Composite
Total Nitrogen (as N)*****						Monitor Only	1 Day/Month	Composite
Boron				Monitor Only		Monitor Only	2 Days/Month	Composite
Cyanide (available)				Monitor Only		Monitor Only	*****	Composite
Total Phosphorus (as P)	267 (667)			1.0			5 Days/Week	Composite
PFAS*****			Monitor Only			Monitor Only	*****	*****
				Monthly Average not less than	Weekly Average not less than	Daily Minimum		
Dissolved Oxygen*****								
March-July				N/A	6.0	5.0	2 Days/Week	Grab
August-February				5.0	4.0	3.5	2 Days/Week	Grab

*Load limits based on design maximum flow shall apply only when flow exceeds design average flow.

**Carbonaceous BOD₅ (CBOD₅) testing shall be in accordance with 40 CFR 136.

***BOD₅ and Suspended Solids (85% removal required): In accordance with 40 CFR 133, the 30-day average percent removal shall not be less than 85 percent. The percent removal need not be reported to the IEPA on DMRs but influent and effluent data must be available, as required elsewhere in this Permit, for IEPA inspection and review. For measuring compliance with this requirement, 5 mg/L shall be added to the effluent CBOD₅ concentration to determine the effluent BOD₅ concentration. Percent removal is a NPDES percentage expression of the removal efficiency across a treatment plant for a given pollutant parameter, as determined from the 30-day average values of the raw wastewater influent concentrations to the facility and the 30-day average values of the effluent pollutant concentrations for a given time period.

****See Special Condition 9.

*****See Special Condition 18.

*****See Special Condition 25.

*****See Special Condition 23.

*****Dissolved Oxygen monitoring shall not be required when the Sangamon River stage exceeds the 25-year flood elevation of 525.11 feet based on the NGVD29 datum.

Flow shall be reported on the Discharge Monitoring Report (DMR) as monthly average and daily maximum.

Fecal Coliform shall be reported on the DMR as a daily maximum value.

pH shall be reported on the DMR as minimum and maximum value.

Chlorine Residual shall be reported on the DMR as daily maximum value.

Boron and Phosphorus and Cyanide shall be reported on the DMR as a monthly average and daily maximum value.

Dissolved oxygen shall be reported on the DMR as a minimum value.

Total Nitrogen shall be reported on the DMR as a daily maximum value. Total Nitrogen is the sum total of Total Kjeldahl Nitrogen, Nitrate, and Nitrite.

NPDES Permit No. IL0021989
Effluent Limitations, Monitoring, and Reporting
 FINAL

Discharge Number(s) and Name(s): 013 Treated Combined Sewage Outfall (Flows up to 147,917 gpm)

These flow facilities shall not be utilized until the main treatment facility is receiving its design maximum flow (DMF)* (flow from 55,555 gpm to 147,917 gpm)

From the effective date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

CONCENTRATION
LIMITS (mg/L)

<u>Parameter</u>	<u>Daily Maximum</u>	<u>Sample Frequency</u>	<u>Sample Type</u>
Total Flow (MG)		Daily When Discharging	Continuous
BOD ₅	Monitor Only	Daily When Discharging	Grab
Suspended Solids	Monitor Only	Daily When Discharging	Grab
Fecal Coliform	Daily Maximum Shall not Exceed 400 per 100 mL	Daily When Discharging	Grab
pH	Shall be in the range of 6 to 9 Standard Units	Daily When Discharging	Grab
Chlorine Residual	0.75	Daily When Discharging	Grab
Ammonia Nitrogen (as N)	Monitor Only	Daily When Discharging	Grab
Total Phosphorus (as P)	Monitor Only	Daily When Discharging	Grab

Total flow in million gallons shall be reported on the Discharge Monitoring Report (DMR) in the quantity maximum column. The main treatment facility flows at the time that Outfall 013 is first utilized shall be reported in the comment section of the DMR in gallons per minute (gpm).

Report the number of days of discharge in the comments section of the DMR.

BOD₅ and Suspended Solids shall be reported on the DMR as a monthly average concentration.

Fecal Coliform and ammonia nitrogen shall be reported on the DMR as daily maximum.

pH shall be reported on the DMR as a minimum and maximum.

Chlorine Residual and Ammonia Nitrogen shall be reported on the DMR as a monthly average concentration.

Total Phosphorus shall be reported on the DMR as a monthly average and daily maximum.

*An explanation shall be provided in the comment section of the DMR should these facilities be used when the main treatment facility is not receiving Design Maximum Flow (DMF). The explanation shall identify the reasons the main facility is at a diminished treatment capacity. Additionally, the Permittee shall comply with the provisions of Special Condition 7.

NPDES Permit No. IL0021989

Influent Monitoring, and Reporting

The influent to the plant shall be monitored as follows:

<u>Parameter</u>	<u>Sample Frequency</u>	<u>Sample Type</u>
Flow (MGD)	Continuous	
BOD ₅	2 Days/Week	Composite
Suspended Solids	2 Days/Week	Composite
PFAS*	*	*

Influent samples shall be taken at a point representative of the influent.

Flow (MGD) shall be reported on the Discharge Monitoring Report (DMR) as monthly average and daily maximum.

BOD₅ and Suspended Solids shall be reported on the DMR as a monthly average concentration.

*See Special Condition 23.

Biosolids Monitoring, and Reporting

<u>Parameter</u>	<u>Sample Frequency</u>	<u>Sample Type</u>
PFAS*	*	*

*See Special Condition 23.

NPDES Permit No. IL0021989

Special Conditions

SPECIAL CONDITION 1. This Permit may be modified to include different final effluent limitations or requirements which are consistent with applicable laws and regulations. The IEPA will public notice the permit modification.

SPECIAL CONDITION 2. The use or operation of this facility shall be by or under the supervision of a Certified Class 1 operator.

SPECIAL CONDITION 3. The IEPA may request in writing submittal of operational information in a specified form and at a required frequency at any time during the effective period of this Permit.

SPECIAL CONDITION 4. The IEPA may request more frequent monitoring by permit modification pursuant to 40 CFR § 122.63 and Without Public Notice.

SPECIAL CONDITION 5. The effluent, alone or in combination with other sources, shall not cause a violation of any applicable water quality standard outlined in 35 Ill. Adm. Code 302 and 303.

SPECIAL CONDITION 6. The Permittee shall record monitoring results on Discharge Monitoring Report (DMR) electronic forms using one such form for each outfall each month.

In the event that an outfall does not discharge during a monthly reporting period, the DMR Form shall be submitted with no discharge indicated.

The Permittee is required to submit electronic DMRs (NetDMRs) instead of mailing paper DMRs to the IEPA unless a waiver has been granted by the Agency. More information, including registration information for the NetDMR program, can be obtained on the IEPA website, <https://epa.illinois.gov/topics/water-quality/surface-water/netdmr.html>.

The completed Discharge Monitoring Report forms shall be submitted to IEPA no later than the 25th day of the following month, unless otherwise specified by the permitting authority.

Permittees that have been granted a waiver shall mail Discharge Monitoring Reports with an original signature to the IEPA at the following address:

Illinois Environmental Protection Agency
Division of Water Pollution Control
Attention: Compliance Assurance Section, Mail Code # 19
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

SPECIAL CONDITION 7. The provisions of 40 CFR Section 122.41(m) & (n) are incorporated herein by reference.

SPECIAL CONDITION 8. Samples taken in compliance with the effluent monitoring requirements shall be taken at a point representative of the discharge, but prior to entry into the receiving stream.

SPECIAL CONDITION 9. Fecal Coliform limits for Discharge Number 007 are effective May thru October. Sampling of Fecal Coliform is only required during this time period.

The total residual chlorine limit is applicable at all times. If the Permittee is chlorinating for any purpose during the months of November through April, sampling is required on a daily grab basis. Sampling frequency for the months of May through October shall be as indicated on effluent limitations, monitoring and reporting page of this Permit.

SPECIAL CONDITION 10.

A. Publicly Owned Treatment Works (POTW) Pretreatment Program General Provisions

1. The Permittee shall implement and enforce its approved Pretreatment Program which was approved on October 23, 1985 and all approved subsequent modifications thereto. The Permittee shall maintain legal authority adequate to fully implement the Pretreatment Program in compliance with Federal (40 CFR 403), State, and local laws and regulations. All definitions in this section unless specifically otherwise defined in this section, are those definitions listed in 40 CFR 403.3. U.S. EPA Region 5 is the Approval Authority for the administration of pretreatment programs in Illinois. The Permittee shall:
 - a. Develop and implement procedures to ensure compliance with the requirements of a pretreatment program as specified in 40 CFR 403.8(f)(2)
 - b. Carry out independent inspection and monitoring procedures at least once per year, which will determine whether each significant industrial user (SIU) is in compliance with applicable pretreatment standards;
 - c. Evaluate whether each SIU needs a slug control plan or other action to control slug discharges. If needed, the SIU slug control plan shall include the items specified in 40 CFR 403.8(f)(2)(vi). For IUs identified as significant prior to November 14, 2005, this evaluation must have been conducted at least once by October 14, 2006; additional SIUs must be evaluated within 1 year of being designated an SIU;
 - d. Update its inventory of Industrial Users (IUs) at least annually and as needed to ensure that all SIUs are properly identified, characterized, and categorized;
 - e. Receive and review self monitoring and other IU reports to determine compliance with all pretreatment standards and

NPDES Permit No. IL0021989

Special Conditions

requirements, and obtain appropriate remedies for noncompliance by any IU with any pretreatment standard and/or requirement;

- f. Investigate instances of noncompliance, collect and analyze samples, and compile other information with sufficient care as to produce evidence admissible in enforcement proceedings, including judicial action;
 - g. Require development, as necessary, of compliance schedules by each industrial user to meet applicable pretreatment standards; and,
 - h. Maintain an adequate revenue structure and staffing level for continued operation of the Pretreatment Program.
2. The Permittee shall issue/reissue permits or equivalent control mechanisms to all SIUs prior to expiration of existing permits or prior to commencement of discharge in the case of new discharges. The permits at a minimum shall include the elements listed in 40 CFR § 403.8(f)(1)(iii)(B).
 3. The Permittee shall develop, maintain, and enforce, as necessary, local limits to implement the general and specific prohibitions in 40 CFR § 403.5 which prohibit the introduction of any pollutant(s) which cause pass through or interference and the introduction of specific pollutants to the waste treatment system from any source of nondomestic discharge.
 - a. General prohibitions. A user may not introduce into a POTW any pollutant(s) which cause pass through or interference.
 - b. Specific prohibitions. In addition, the following pollutants shall not be introduced into a POTW:
 - i. Pollutants which create a fire or explosion hazard in the POTW, including, but not limited to, wastestreams with a closed cup flashpoint of less than 140 degrees Fahrenheit or 60 degrees Centigrade using the test methods specified in 40 CFR 261.21;
 - ii. Pollutants which will cause corrosive structural damage to the POTW, but in no case discharges with pH lower than 5.0, unless the works is specifically designed to accommodate such discharges;
 - iii. Solid or viscous pollutants in amounts which will cause obstruction to the flow in the POTW resulting in Interference;
 - iv. Any pollutant, including oxygen demanding pollutants (BOD, etc.) released in a discharge at a flow rate and/or pollutant concentration which will cause Interference with the POTW.
 - v. Heat in amounts which will inhibit biological activity in the POTW resulting in Interference, but in no case heat in such quantities that the temperature at the POTW Treatment Plant exceeds 40 °C (104 °F) unless the Approval Authority, upon request of the POTW, approves alternate temperature limits.
 - vi. Petroleum oil, nonbiodegradable cutting oil, or products of mineral oil origin in amounts that will cause interference or pass through;
 - vii. Pollutants which result in the presence of toxic gases, vapors, or fumes within the POTW in a quantity that may cause acute worker health and safety problems;
 - viii. Any trucked or hauled pollutants, except at discharge points designated by the POTW.
 4. In addition to the general limitations expressed in Paragraph 3 above, applicable pretreatment standards must be met by all industrial users of the POTW. These limitations include specific standards for certain industrial categories as determined by Section 307(b) and (c) of the Clean Water Act, State limits, or local limits, whichever are more stringent.
 5. The USEPA and IEPA individually retain the right to take legal action against any industrial user and/or the POTW for those cases where an industrial user has failed to meet an applicable pretreatment standard by the deadline date regardless of whether or not such failure has resulted in a permit violation.
 6. The Permittee shall establish agreements with all contributing jurisdictions, as necessary, to enable it to fulfill its requirements with respect to all IUs discharging to its system.
 7. Unless already completed, the Permittee shall within six (6) months of the effective date of this Permit submit to USEPA and IEPA a proposal to modify and update its approved Pretreatment Program to incorporate Federal revisions to the general pretreatment regulations. The proposal shall include all changes to the approved program and the sewer use ordinance which are necessary to incorporate the revisions of the Pretreatment Streamlining Rule (which became effective on November 14, 2005), which are considered required changes, as described in the Pretreatment Streamlining Rule Fact Sheet 2.0: Required changes, available at: http://cfpub.epa.gov/npdes/whatsnew.cfm?program_id=3. This includes any necessary revisions to the Permittee's Enforcement Response Plan (ERP).
 8. Within 6 months from the effective date of this permit, the Permittee shall conduct a technical re-evaluation of its local limitations consistent with U.S. EPA's Local Limits Development Guidance (July 2004), and submit the evaluation and any proposed revisions to its local limits to IEPA and U.S. EPA Region 5 for review and approval. U.S. EPA Region 5 will request Permittee to submit the evaluation and any proposed revisions to its local limits on the spreadsheet "Region 5 Pretreatment Limit Spreadsheet Illinois/Indiana" found at: <https://www.epa.gov/npdes-permits/illinois-npdes-permits>. To demonstrate technical justification for new local industrial user limits or justification for retaining existing limits, the following information must be submitted to U.S. EPA:

NPDES Permit No. IL0021989

Special Conditions

- a. Total plant flow
- b. Domestic/commercial pollutant contributions for pollutants of concern
- c. Industrial pollutant contributions and flows
- d. Current POTW pollutant loadings, including loadings of conventional pollutants
- e. Actual treatment plant removal efficiencies, as a decimal (primary, secondary, across the wastewater treatment plant)
- f. Safety factor to be applied
- g. Identification of applicable criteria:
 - i. NPDES permit conditions
 - Specific NPDES effluent limitations
 - Water-quality criteria
 - Whole effluent toxicity requirements
 - Criteria and other conditions for sludge disposal
 - ii. Biological process inhibition
 - Nitrification
 - Sludge digester
 - iii. Collection system problems
- h. The Permittee's sludge disposal methods (land application, surface disposal, incineration, landfill)
- i. Sludge flow to digester
- j. Sludge flow to disposal
- k. % solids in sludge to disposal, not as a decimal
- l. % solids in sludge to digester, not as a decimal
- m. Plant removal efficiencies for conventional pollutants
- n. If revised industrial user discharge limits are proposed, the method of allocating available pollutants loads to industrial users
- o. A comparison of maximum allowable headworks loadings based on all applicable criteria listed in g, above
- p. Pollutants that have caused:
 - i. Violations or operational problems at the POTW, including conventional pollutants
 - ii. Fires and explosions
 - iii. Corrosion
 - iv. Flow obstructions
 - v. Increased temperature in the sewer system
 - vi. Toxic gases, vapors or fumes that caused acute worker health and safety problems
 - vii. Toxicity found through Whole Effluent Toxicity testing
 - viii. Inhibition
- q. Pollutants designated as "monitoring only" in the NPDES permit
- r. Supporting data, assumptions, and methodologies used in establishing the information a through q above

B. Reporting and Records Requirements

1. The Permittee shall provide an annual report briefly describing the permittee's pretreatment program activities over the previous calendar year. Permittees who operate multiple plants may provide a single report providing all plant-specific reporting requirements are met. Such report shall be submitted no later than April 28 of each year to USEPA, Region 5, 77 West Jackson Blvd., Chicago, Illinois 60604, Attention: Water Enforcement & Compliance Assurance Branch, and shall be in the format set forth in IEPA's POTW Pretreatment Report Package which contains information regarding:
 - a. An updated listing of the Permittee's significant industrial users, indicating additions and deletions from the previous year, along with brief explanations for deletions. The list shall specify which categorical Pretreatment standards, if any, are applicable to each Industrial User.
 - b. A descriptive summary of the compliance activities including numbers of any major enforcement actions, (i.e., administrative orders, penalties, civil actions, etc.), and the outcome of those actions. This includes an assessment of the compliance status of the Permittee's industrial users and the effectiveness of the Permittee's Pretreatment Program in meeting its needs and objectives.
 - c. A description of all substantive changes made to the Permittee's Pretreatment Program. Changes which are "substantial modifications" as described in 40 CFR § 403.18(c) must receive prior approval from the USEPA.
 - d. Results of sampling and analysis of POTW influent, effluent, and sludge.
 - e. A summary of the findings from the priority pollutants sampling. As sufficient data becomes available the IEPA may modify this Permit to incorporate additional requirements relating to the evaluation, establishment, and enforcement of local limits for organic pollutants. Any permit modification is subject to formal due process procedures pursuant to State and Federal law and regulation. Upon a determination that an organic pollutant is present that causes interference or pass through, the Permittee shall establish local limits as required by 40 CFR § 403.5(c).
2. The Permittee shall maintain all pretreatment data and records for a minimum of three (3) years. This period shall be extended during the course of unresolved litigation or when requested by the IEPA or the Regional Administrator of USEPA. Records shall be available to USEPA and the IEPA upon request.

NPDES Permit No. IL0021989

Special Conditions

3. The Permittee shall establish public participation requirements of 40 CFR 25 in implementation of its Pretreatment Program. The Permittee shall at least annually, publish the names of all IU's which were in significant noncompliance (SNC), as defined by 40 CFR § 403.8(f)(2)(viii), in a newspaper of general circulation that provides meaningful public notice within the jurisdictions served by the Permittee or based on any more restrictive definition of SNC that the POTW may be using.
4. The Permittee shall provide written notification to the USEPA, Region 5, 77 West Jackson Blvd., Chicago, Illinois 60604, Attention: NPDES Programs Branch and to the Deputy Counsel for the Division of Water Pollution Control, IEPA, 1021 North Grand Avenue East, P.O. Box 19276, Springfield, Illinois 62794-9276 within five (5) days of receiving notice that any Industrial User of its sewage treatment plant is appealing to the Circuit Court any condition imposed by the Permittee in any permit issued to the Industrial User by Permittee. A copy of the Industrial User's appeal and all other pleadings filed by all parties shall be mailed to the Deputy Counsel within five (5) days of the pleadings being filed in Circuit Court.

C. Monitoring Requirements

1. The Permittee shall monitor its influent, effluent and sludge beginning 3 months from the effective date of this permit and report concentrations of the following parameters on Discharge Monitoring Report (DMR) electronic forms, unless otherwise specified by the IEPA, and include them in its annual report. Samples shall be taken at semi-annual intervals at the indicated reporting limit or better and consist of a 24-hour composite unless otherwise specified below. Sludge samples shall be taken of final sludge and consist of a grab sample reported on a dry weight basis.

STORET CODE	PARAMETER	Minimum reporting limit
01097	Antimony	0.07 mg/L
01002	Arsenic	0.05 mg/L
01007	Barium	0.5 mg/L
01012	Beryllium	0.005 mg/L
01027	Cadmium	0.001 mg/L
01032	Chromium (hex) (grab not to exceed 24 hours)*	0.01 mg/L
01034	Chromium (total)	0.05 mg/L
01042	Copper	0.005 mg/L
00720	Cyanide (total) (grab)****	5.0 µg/L
00722	Cyanide (grab)*(available ***** or amenable to chlorination)****	5.0 µg/L
00951	Fluoride*	0.1 mg/L
01045	Iron (total)	0.5 mg/L
01046	Iron (Dissolved)*	0.5 mg/L
01051	Lead	0.05 mg/L
01055	Manganese	0.5 mg/L
71900	Mercury (effluent grab)***	1.0 ng/L**
01067	Nickel	0.005 mg/L
00556	Oil (hexane soluble or equivalent) (Grab Sample only)*	5.0 mg/L
32730	Phenols (grab)	0.005 mg/L
01147	Selenium	0.005 mg/L
01077	Silver (total)	0.003 mg/L
01059	Thallium	0.3 mg/L
01092	Zinc	0.025 mg/L

* Influent and effluent only

**1 ng/L = 1 part per trillion.

***Utilize USEPA Method 1631E and the digestion procedure described in Section 11.1.1.2 of 1631E, other approved methods may be used for influent (composite) and sludge.

****Analysis for cyanide (available or amenable to chlorination) is only required if cyanide (total) is detected at or above the minimum reporting limit.

*****USEPA Method OIA – 1677 or Standard Method SM 4500-CN G.

The minimum reporting limit for each parameter is specified by Illinois EPA as the regulatory authority.

The minimum reporting limit for each parameter shall be greater than or equal to the lowest calibration standard and within the acceptable calibration range of the instrument.

The minimum reporting limit is the value below which data are to be reported as non-detects.

The statistically-derived laboratory method detection limit for each parameter shall be less than the minimum reporting limit required for that parameter.

All sample containers, chemical and thermal preservation, holding times, analyses, method detection limit determinations and quality assurance/quality control requirements shall be in accordance with 40 CFR Part 136.

Unless otherwise indicated, concentrations refer to the total amount of the constituent present in all phases, whether solid, suspended or dissolved, elemental or combined including all oxidation states. Where constituents are commonly measured as

NPDES Permit No. IL0021989

Special Conditions

other than total, the phase is so indicated.

2. The Permittee shall conduct an analysis for the one hundred and ten (110) organic priority pollutants identified in 40 CFR 122 Appendix D, Table II as amended. This monitoring shall be done annually and reported on monitoring report forms provided by the IEPA and shall consist of the following:
 - a. The influent and effluent shall be sampled and analyzed for the one hundred and ten (110) organic priority pollutants. The sampling shall be done during a day when industrial discharges are expected to be occurring at normal to maximum levels.

Samples for the analysis of acid and base/neutral extractable compounds shall be 24-hour composites.

Five (5) grab samples shall be collected each monitoring day to be analyzed for volatile organic compounds. A single analysis for volatile pollutants (Method 624) may be run for each monitoring day by compositing equal volumes of each grab sample directly in the GC purge and trap apparatus in the laboratory, with no less than one (1) mL of each grab included in the composite.

Wastewater samples must be handled, prepared, and analyzed by GC/MS in accordance with USEPA Methods 624 and 625 of 40 CFR 136 as amended.
 - b. The sludge shall be sampled and analyzed for the one hundred and ten (110) organic priority pollutants. A sludge sample shall be collected concurrent with a wastewater sample and taken as final sludge.

Sampling and analysis shall conform to USEPA Methods 624 and 625 unless an alternate method has been approved by IEPA.
 - c. Sample collection, preservation and storage shall conform to approved USEPA procedures and requirements.
3. In addition, the Permittee shall monitor any new toxic substances as defined by the Clean Water Act, as amended, following notification by the IEPA or U.S. EPA.
4. Permittee shall report any noncompliance with effluent or water quality standards in accordance with Standard Condition 12(f) of this Permit.
5. Analytical detection limits shall be in accordance with 40 CFR 136. Minimum detection limits for sludge analyses shall be in accordance with 40 CFR 503.

D. Pretreatment Reporting

US EPA Region 5 is the approval Authority for administering the pretreatment program in Illinois. All requests for modification of pretreatment program elements should be submitted in redline/strikeout electronic format and must be sent to US EPA at r5npdes@epa.gov.

Permittee shall upon notice from US EPA, modify any pretreatment program element found to be inconsistent with 40 CFR 403.

SPECIAL CONDITION 11. During January of each year the Permittee shall submit annual fiscal data regarding sewerage system operations to the Illinois Environmental Protection Agency/Division of Water Pollution Control/Compliance Assurance Section. The Permittee may use any fiscal year period provided the period ends within twelve (12) months of the submission date.

Submission shall be on forms provided by IEPA titled "Fiscal Report Form For NPDES Permittees".

SPECIAL CONDITION 12. The Permittee shall conduct biomonitoring of the effluent from Discharge Number 007.

Biomonitoring

- A. Acute Toxicity - Standard definitive acute toxicity tests shall be run on at least two trophic levels of aquatic species (fish, invertebrate) representative of the aquatic community of the receiving stream. Testing must be consistent with Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms (Fifth Edition) EPA/821-R-02-012, October 2002, and Whole Effluent Toxicity Methods Errata Sheet EPA/821-R-01-012-ES, December 2016. Unless substitute tests are pre-approved; the following tests are required:
 1. Fish 96-hour static LC₅₀ Bioassay using fathead minnows (*Pimephales promelas*).
 2. Invertebrate 48-hour static LC₅₀ Bioassay using *Ceriodaphnia*.
- B. Testing Frequency - The above tests shall be conducted using 24-hour composite samples unless otherwise authorized by the IEPA. Sample collection and testing must be conducted in the 18th, 15th, 12th, and 9th month prior to the expiration date of this Permit. When possible, bioassay sample collection should coincide with sample collection for metals analysis or other parameters that may contribute to effluent toxicity.
- C. Reporting - Results shall be reported according to EPA/821-R-02-012, Section 12, Report Preparation, and shall be emailed to EPA.PrmtSpecCondtns@Illinois.gov with "IL0021989 Special Condition 12" as the subject of the email within one week of receipt from the laboratory. Reports are due to the IEPA no later than the 16th, 13th, 10th, and 7th month prior to the expiration date of this Permit.

NPDES Permit No. IL0021989

Special Conditions

- D. Toxicity – Should a bioassay result in toxicity to >20% of organisms tested in the 100% effluent treatment, the IEPA may require, upon notification, six (6) additional rounds of monthly testing on the affected organism(s) to be initiated within 30 days of the toxic bioassay. Results shall be submitted to IEPA within one (1) week of becoming available to the Permittee. Should any of the additional bioassays result in toxicity to $\geq 50\%$ of organisms tested in the 100% effluent treatments, the Permittee must contact the IEPA within one (1) day of the results becoming available to the Permittee and begin the toxicity identification and reduction evaluation process as outlined below.
- E. Toxicity Identification and Reduction Evaluation - Should any of the additional bioassays result in toxicity to $\geq 50\%$ of organisms tested in the 100% effluent treatment, the Permittee must contact the IEPA within one (1) day of the results becoming available to the Permittee and begin the toxicity identification evaluation process in accordance with Methods for Aquatic Toxicity Identification Evaluations, EPA/600/6-91/003. The IEPA may also require, upon notification, that the Permittee prepare a plan for toxicity reduction evaluation to be developed in accordance with Toxicity Reduction Evaluation Guidance for Municipal Wastewater Treatment Plants, EPA/833B-99/002, which shall include an evaluation to determine which chemicals have a potential for being discharged in the plant wastewater, a monitoring program to determine their presence or absence and to identify other compounds which are not being removed by treatment, and other measures as appropriate. The Permittee shall submit to the IEPA its plan for toxicity reduction evaluation within ninety (90) days following notification by the IEPA. The Permittee shall implement the plan within ninety (90) days or other such date as contained in a notification letter received from the IEPA.

The IEPA may modify this Permit during its term to incorporate additional requirements or limitations based on the results of the biomonitoring. In addition, after review of the monitoring results, the IEPA may modify this Permit to include numerical limitations for specific toxic pollutants. Modifications under this condition shall follow public notice and opportunity for hearing.

SPECIAL CONDITION 13. For the duration of this Permit, the Permittee shall determine the quantity of sludge produced by the treatment facility in dry tons or gallons with average percent total solids analysis. The Permittee shall maintain adequate records of the quantities of sludge produced and have said records available for U.S. EPA and IEPA inspection. The Permittee shall submit to the IEPA, at a minimum, a semi-annual summary report of the quantities of sludge generated and disposed of, in units of dry tons or gallons (average total percent solids) by different disposal methods including but not limited to application on farmland, application on reclamation land, landfiling, public distribution, dedicated land disposal, sod farms, storage lagoons or any other specified disposal method. Said reports shall be submitted to the IEPA by January 31 and July 31 of each year reporting the preceding January thru June and July thru December interval of sludge disposal operations.

Duty to Mitigate. The Permittee shall take all reasonable steps to minimize any sludge use or disposal in violation of this Permit.

Sludge monitoring must be conducted according to test procedures approved under 40 CFR 136 unless otherwise specified in 40 CFR 503, unless other test procedures have been specified in this Permit.

Planned Changes. The Permittee shall give notice to the IEPA on the semi-annual report of any changes in sludge use and disposal.

The Permittee shall retain records of all sludge monitoring, and reports required by the Sludge Permit as referenced in Standard Condition 25 for a period of at least five (5) years from the date of this Permit.

If the Permittee monitors any pollutant more frequently than required by this permit or the Sludge Permit, the results of this monitoring shall be included in the reporting of data submitted to the IEPA.

The Permittee shall comply with existing federal regulations governing sewage sludge use or disposal and shall comply with all existing applicable regulations in any jurisdiction in which the sewage sludge is actually used or disposed.

The Permittee shall comply with standards for sewage sludge use or disposal established under section 405(d) of the CWA within the time provided in the regulations that establish the standards for sewage sludge use or disposal even if the permit has not been modified to incorporate the requirement.

The Permittee shall ensure that the applicable requirements in 40 CFR Part 503 are met when the sewage sludge is applied to the land, placed on a surface disposal site, or fired in a sewage sludge incinerator.

Monitoring reports for sludge shall be reported on the form titled "Sludge Management Reports" to the following address:

Illinois Environmental Protection Agency
Bureau of Water
Compliance Assurance Section
Mail Code #19
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

SPECIAL CONDITION 14.

AUTHORIZATION OF
COMBINED SEWER AND TREATMENT PLANT DISCHARGES

The IEPA has determined that at least a portion of the collection system consists of combined sewers. References to the collection system and the sewer system refer only to those parts of the system which are owned and operated by the Permittee unless otherwise

NPDES Permit No. IL0021989

Special Conditions

indicated. The Permittee is authorized to discharge from the overflow(s)/bypass(es) listed below provided the diversion structure is located on a combined sewer and the following terms and conditions are met:

<u>Discharge Number</u>	<u>Latitude</u>	<u>Longitude</u>	<u>Receiving Water</u>
001 Oak Knolls CSO	39° 48' 54" North	89° 41' 58" West	Spring Creek
002 Amos Branch CSO	39° 48' 39" North	89° 40' 36" West	Town Branch
003 Town Branch CSO	39° 49' 17" North	89° 41' 05" West	Town Branch
005 Oak Ridge CSO	39° 49' 34" North	89° 39' 38" West	Spring Creek
006 Fairgrounds CSO	39° 50' 08" North	89° 38' 59" West	Spring Creek

A. CSO Monitoring, Reporting and Notification Requirements

1. The Permittee shall monitor the frequency of discharge (number of discharges per month) and estimate the duration (in hours) of each discharge from each outfall listed in this Special Condition. Estimates of storm duration and total rainfall shall be provided for each storm event.

CSO Outfalls that Discharged

Rain Event Start Date	Estimated Duration (hours)	Estimated Rainfall (inches)	Outfall Number	Outfall Description	Est. Discharge Duration (hrs.)	Est. Discharge Volume (MG)
--------------------------	-------------------------------	--------------------------------	----------------	---------------------	-----------------------------------	-------------------------------

For frequency reporting, all discharges from the same storm, or occurring within 24 hours, shall be reported as one. The date that a discharge commences shall be recorded for each outfall. Reports shall on the CSO Discharge Monitoring Report form, IL532-2471, which is available on the following webpage: <https://epa.illinois.gov/topics/forms/water-forms/wastewater-compliance.html>. These forms shall be submitted to the IEPA monthly with the DMRs and covering the same reporting period as the DMRs. Parameters (other than flow frequency and volume), if required in this Permit, shall be sampled and reported as indicated in the transmittal letter for such report forms.

2. All Submittals listed in this Special Condition can be submitted electronically to EPA.PrmtSpecCondtns@illinois.gov with "IL0021989 Special Condition 14" as the subject of the email.

B. CSO Treatment Requirements

1. All combined sewer overflows and treatment plant bypasses shall be given sufficient treatment to prevent pollution and the violation of applicable water quality standards. Sufficient treatment consists of the following:
All dry weather flows and the first flush of storm flows shall meet all applicable effluent standards and the effluent limitations as required for the main STP outfall;
 - a. Additional flows, but not less than ten times the average dry weather flow for the design year, shall receive a minimum of primary treatment and disinfection with adequate retention time; and
 - b. Any additional treatment, necessary to comply with all applicable water quality based requirements of this Permit including, but not limited to, the requirement that discharges from CSOs not cause or contribute to violations of applicable water quality standards or cause use impairment in the receiving waters.
2. All CSO discharges authorized by this Permit shall be treated, in whole or in part, to the extent necessary to prevent accumulations of sludge deposits, floating debris and solids in accordance with 35 Ill. Adm. Code 302.203 and to prevent depression of oxygen levels below the applicable water quality standards.
3. Overflows during dry weather are prohibited. Dry weather overflows shall be reported to the IEPA pursuant to Standard Condition 12(f) of this Permit (24 hour notice).
4. The collection system shall be operated to optimize transport of wastewater flows and to minimize CSO discharges and the treatment system shall be operated to maximize treatment of wastewater flows.

C. CSO Nine Minimum Controls

1. The Permittee shall comply with the nine minimum controls contained in the National CSO Control Policy published in the Federal Register on April 19, 1994. The nine minimum controls are:
 - a. Proper operation and maintenance programs for the sewer system and the CSOs;
 - b. Maximum use of the collection system for storage;
 - c. Review and modification of pretreatment requirements to assure CSO impacts are minimized;
 - d. Maximization of flow to the POTW for treatment;
 - e. Prohibition of CSOs during dry weather;
 - f. Control of solids and floatable materials in CSOs;

NPDES Permit No. IL0021989

Special Conditions

- g. Pollution prevention programs which focus on source control activities;
 - h. Public notification to ensure that citizens receive adequate information regarding CSO occurrences and CSO impacts; and,
 - i. Monitoring to characterize impacts and efficiency of CSO controls.
2. A CSO pollution prevention plan (PPP) shall be developed by the Permittee unless one has already been prepared for this collection system. Any previously-prepared PPP shall be reviewed, and revised if necessary, by the Permittee to address the items contained in Chapter 8 of the U.S. EPA guidance document, Combined Sewer Overflows, Guidance For Nine Minimum Controls, and any items contained in previously-sent review documents from the IEPA concerning the PPP. Combined Sewer Overflows, Guidance For Nine Minimum Controls is available on line at <https://www3.epa.gov/npdes/pubs/owm0030.pdf>. The PPP (or revised PPP) shall be presented to the general public at a public information meeting conducted by the Permittee annually during the term of this Permit. The Permittee shall submit documentation that the pollution prevention plan complies with the requirements of this Permit and that the public information meeting was held. Such documentation shall be submitted to the IEPA within twelve (12) months of the effective date of this Permit and shall include a summary of all significant issues raised by the public, the Permittee's response to each issue, and two (2) copies of the "CSO Pollution Prevention Plan Certification" one (1) with original signatures. This certification form is available online at <https://epa.illinois.gov/topics/forms/water-forms/wastewater-compliance.html>. Following the public meeting, the Permittee shall implement the pollution prevention plan and shall maintain a current pollution prevention plan, updated to reflect system modifications, on file at the sewage treatment works or other acceptable location and made available to the public. The pollution prevention plan revisions shall be submitted to the IEPA one (1) month from the revision date.

D. Sensitive Area Considerations

1. Pursuant to Section II.C.3 of the federal CSO Control Policy of 1994, sensitive areas are any water likely to be impacted by a CSO discharge which meet one or more of the following criteria: (1) designated as an Outstanding National Resource Water; (2) found to contain shellfish beds; (3) found to contain threatened or endangered aquatic species or their habitat; (4) used for primary contact recreation; (5) National Marine Sanctuaries; or, (6) within the protection area for a drinking water intake structure.

The IEPA has tentatively determined that none of the outfalls listed in this Special Condition discharge to sensitive areas. However, if information becomes available that causes the IEPA to reverse this determination, the IEPA will notify the Permittee in writing. Upon the date contained in the notification letter, the Permittee shall revise the LTCP and schedule to eliminate or relocate these outfalls. If elimination or relocation is not economically feasible or technically achievable the Permittee shall submit a revised plan and schedule for treating the discharge. Such justification shall be in accordance with Section II.C.3 of the National CSO Control Policy.

E. CSO Operational and Maintenance Plans

1. The Permittee shall implement measures to reduce, to the greatest extent practicable, the total loading of pollutants and floatables entering the receiving stream to ensure that the Permittee ultimately achieves compliance with water quality standards. These measures shall include, but not be limited to developing and implementing a CSO O&M plan, tailored to the permittee's collection and waste treatment systems, which shall include mechanisms and specific procedures where applicable to ensure:
- a. Collection system inspection on a scheduled basis;
 - b. Sewer, catch basin, and regulator cleaning and maintenance on a scheduled basis;
 - c. Inspections are made and preventive maintenance is performed on all pump/lift stations;
 - d. Collection system replacement, where necessary;
 - e. Detection and elimination of illegal connections;
 - f. Detection, prevention, and elimination of dry weather overflows;
 - g. The collection system is operated to maximize storage capacity and the combined sewer portions of the collection system are operated to delay storm entry into the system; and,
 - h. The treatment and collection systems are operated to maximize treatment.

The IEPA reviewed and accepted a CSO operational and maintenance plan "CSO O&M plan" on February 9, 1996 prepared for this sewerage system. The Permittee shall fully implement the approved plan and review and revise, if needed, the CSO O&M plan to reflect system changes.

The CSO O&M plan shall be presented to the general public at a public information meeting conducted by the Permittee within nine (9) months of the effective date of this Permit or within nine (9) months of the CSO system being modified. The Permittee shall submit documentation that the CSO O&M plan complies with the requirements of this Permit and that the public information meeting was held. Such documentation shall be submitted to the IEPA within twelve (12) months of the effective date of this Permit or within three (3) months of the public meeting and shall include a summary of all significant issues raised by the public, the Permittee's response to each issue, and two (2) copies of the "CSO Operational Plan Checklist and Certification", one (1) with original signatures. Copies of the "CSO Operational Plan Checklist and Certification" are available online at <https://epa.illinois.gov/topics/forms/water-forms/wastewater-compliance.html>. Following the public meeting, the Permittee shall

NPDES Permit No. IL0021989

Special Conditions

maintain a current CSO O&M plan, updated to reflect system modifications, on file at the sewage treatment works and made available to the public. The CSO O&M plan revisions shall be submitted to the IEPA one (1) month from the revision date.

F. Sewer Use Ordinances

1. The Permittee, within six (6) months of the effective date of this Permit, shall review and where necessary, modify its existing sewer use ordinance to ensure it contains provisions addressing the conditions below. If no ordinance exists, such ordinance shall be developed and implemented within six (6) months from the effective date of this Permit. Upon completion of the review of the sewer use ordinance(s), the Permittee shall submit two (2) copies of a completed "Certification of Sewer Use Ordinance Review", one (1) with original signatures. Copies of the certification form can be obtained on the following webpage: <https://epa.illinois.gov/topics/forms/water-forms/wastewater-permits.html>. The Permittee shall submit copies of the sewer use ordinance(s) to the IEPA one (1) month from the revision date. Sewer use ordinances are to contain specific provisions to:
 - a. Prohibit introduction of new inflow sources to the sanitary sewer system;
 - b. Require that new construction tributary to the combined sewer system be designed to minimize and/or delay inflow contribution to the combined sewer system;
 - c. Require that inflow sources on the combined sewer system be connected to a storm sewer, within a reasonable period of time, if a storm sewer becomes available;
 - d. Provide that any new building domestic waste connection shall be distinct from the building inflow connection, to facilitate disconnection if a storm sewer becomes available;
 - e. Assure that CSO impacts from non-domestic sources are minimized by determining which non-domestic discharges, if any, are tributary to CSOs and reviewing, and, if necessary, modifying the sewer use ordinance to control pollutants in these discharges; and,
 - f. Assure that the owners of all publicly owned systems with combined sewers tributary to the Permittee's collection system have procedures in place adequate to ensure that the objectives, mechanisms, and specific procedures given in Paragraph E of this Special Condition are achieved.

The Permittee shall enforce the applicable sewer use ordinances.

G. Long-Term Control Planning and Compliance with Water Quality Standards

1.
 - a. Pursuant to Section 301 of the Federal Clean Water Act, 33 U.S.C. § 1311 and 40 CFR § 122.4, discharges from the CSOs, including the outfalls listed in this Special Condition and any other outfall listed as a "Treated Combined Sewage Outfall", shall not cause or contribute to violations of applicable water quality standards or cause use impairment in the receiving waters. In addition, discharges from CSOs shall comply with all applicable parts of 35 Ill. Adm. Code 306.305 (a), (b), (c), and (d).
 - b. This is a Phase II Permit under USEPA's 1994 Policy requiring implementation of the LTCP approved by IEPA on August 19, 2016. The implementation schedule can be found under the additional Action Items and Required Reporting of this Special Condition (Item H.1.b). Consistent with the design conditions of the LTCP, the numeric water quality based effluent limitations for the CSOs in this permit are that there shall be no less than 85% elimination or capture for treatment by volume of the combined sewage collected in the CSS during precipitation events on a system-wide annual average basis. This limitation shall become effective on December 31, 2035. All provisions of this Special Condition shall stay in effect prior to and after completion of construction. Project reports shall be submitted to the Agency six (6) months from the effective date of this Permit and every six (6) months thereafter.
 - c. Upon completion of construction, post-construction monitoring shall be implemented for a twenty-four (24) month period. Within thirty (30) months of completion of construction, the results shall be submitted to the IEPA along with recommendations and conclusions as to whether or not the discharges from any of the CSOs (treated or untreated) authorized by this Permit are causing or contributing to violations of applicable water quality standards or causing use impairment in the receiving water(s).
 - d. Should the results of the post-construction water quality monitoring plan or if information becomes available that causes IEPA to conclude that the discharges from any of the CSOs (treated or untreated) authorized to discharge under this Permit are causing or contributing to violations of water quality standards or are causing use impairment in the receiving water(s), the IEPA will notify the Permittee in writing. Upon receiving such notification, the Permittee shall develop and implement a revised CSO Long-Term Control Plan (LTCP) for assuring that discharges from the CSOs (treated or untreated) comply with the provisions of Paragraph G.1.a above and a schedule for implementation of the measures. Three (3) copies of the revised LTCP shall be submitted to the IEPA within twelve (12) months of receiving the IEPA written notice.

Following submittal of the revised LTCP, the Permittee shall respond to any initial IEPA review letter in writing within ninety (90) days of the date of such a review letter, and within thirty (30) days of any subsequent review letter(s), if any. Implementation of the revised LTCP shall be as indicated by IEPA in writing or other enforceable mechanism.

NPDES Permit No. IL0021989

Special Conditions

2. A public notification program in accordance with Section II.B.8 of the federal CSO Control Policy of 1994 shall be developed employing a process that actively informs the affected public. The program shall include at a minimum public notification of CSO occurrences and CSO impacts, with consideration given to including mass media and/or Internet notification. The Permittee shall post and maintain signs in waters likely to be impacted by CSO discharges at the point of discharge and at points where these waters are used for primary contact recreation. The sign's message should be visible from both shoreline and water vessel approach (if appropriate), respectively. Provisions shall be made to include modifications of the program when necessary and notification to any additional member of the affected public. The program shall be presented to the general public at a public information meeting conducted by the Permittee. The Permittee shall conduct the public information meeting providing a summary and status of the CSO control program annually during the term of this Permit. The Permittee shall submit documentation that the public information meeting was held, shall submit a summary of all significant issues raised by the public and the Permittee's response to each issue and shall identify any modifications to the program as a result of the public information meeting within 60 days of holding the public meeting. The Permittee shall submit copies of the public notification program to the IEPA upon written request.
3. If any of the CSO discharge points listed in this Special Condition are eliminated, or if additional CSO discharge points, not listed in this Special Condition, are discovered, the Permittee shall notify the IEPA in writing within one (1) month of the respective outfall elimination or discovery. Such notification shall be in the form of a request for the appropriate modification of this NPDES Permit.

H. Summary of Compliance Dates in this CSO Special Condition

1.

- a. The following summarizes the dates that submittals contained in this Special Condition are due at the IEPA (unless otherwise stated)

<u>Submittal to IEPA</u>	<u>Condition No.</u>	<u>Due Date(s)</u>
Submission of CSO Monitoring Data	Paragraph A.1	25 th of every month
Submission of Revised CSO O&M Plan	Paragraph E.1	1 month from revision date
Elimination of a CSO or Discovery of Additional CSO Locations	Paragraph G.3	1 month from discovery or elimination
Certification of Sewer Use Ordinance Review	Paragraph F.1	6 months from the effective date of this Permit
Conduct PPP Public Information meeting No Submittal Due with this Milestone	Paragraph C.1	Annually
Conduct PN Public Information meeting No Submittal Due with this Milestone	Paragraph G.2	Annually
Conduct O&M Plan Public Information Meeting No Submittal Due with this Milestone	Paragraph E.1	9 months from the effective date of this Permit
Submit PPP Certification	Paragraph C.2	12 months from the effective date of this Permit
Submit O&M Plan Certification	Paragraph E.1	12 months from the effective date of this Permit
Submit PN Information Meeting Summary	Paragraph G.2	60 days after the public meeting
Submit CSO Long-Term Control Plan	Paragraph G.1	12 months from the date of IEPA notification
CSO Long Term Control	Paragraph G.1.b	December 31, 2035

- b. Additional Action Items and Required Reporting

Progress Reports	6 months from the effective date and every 6 months thereafter until operational attainment
Bond and Patton CSO Closure	Completed
Improve Oak Ridge Interceptor Sewer Connection	December 31, 2026
Improve Floatables Control	December 31, 2029
Modifications to maximize System Storage and Flow to WWTP	December 31, 2029
CSO Treatment Facility Improvements	December 31, 2031
Town Branch Channel Repair	December 31, 2034

NPDES Permit No. IL0021989

Special Conditions

Green Infrastructure Program

December 31, 2035

Submit Post-Construction Compliance Monitoring Plan

December 31, 2034

Begin to Implement Post-Construction Monitoring Plan

6 months from Agency Approval

Improvements will include closing the Bond & Patton overflow (004) and removing two separate storm sewers from its combined sewer system (CSS)(Completed); diversion structure and regulator structure weirs will be raised to maximize storage in the collection system at the remaining overflows; restrictor plates will be removed at Oak Knolls (001) and Ridgely Park (006); slide gates will be replaced in the Town Branch (003) diversion structure and in its regulator structure; flap gates will be replaced with backflow prevention valves in Oak Knolls, Amos Branch (002), and Oak Ridge (005) diversion structures; discharge from the Jefferson Street detention pond will be rerouted from Amos Branch CSS to storm flow (Town Branch channel); solids and floatables controls will be installed at all diversion structures; and the connecting sewer from the Oak Ridge diversion structure to the interceptor sewer will be increased in size from 21-inch to 42-inch diameter. The existing CSO treatment facilities will be rehabilitated, with improvements to include adding two wet weather flow pumps and a 48-inch forcemain to the Spring Creek pump station to convey an additional 40 MGD; replacement of the bar screen; replacement of the CSO clarifier mechanisms; dredging of the tertiary and CSO ponds; and upgrading disinfection equipment and installing flow metering equipment. The Town Branch channel will be repaired. A green infrastructure program will be implemented in the Spring Creek CSS areas.

All Submittals listed in this Special Condition can be submitted electronically to EPA.PrmtSpecCondtns@illinois.gov with "IL0021989 Special Condition 14" as the subject of the email.

I. Reopening and Modifying this Permit

1. The IEPA may initiate a modification for this Permit at any time to include requirements and compliance dates which have been submitted in writing by the Permittee and approved by the IEPA, or other requirements and dates which are necessary to carry out the provisions of the Illinois Environmental Protection Act, the Clean Water Act, or regulations promulgated under those Acts. Public Notice of such modifications and opportunity for public hearing shall be provided.

SPECIAL CONDITION 15. This Permit may be modified to include alternative or additional final effluent limitations pursuant to an approved Total Maximum Daily Load (TMDL) Study or upon completion of an alternate Water Quality Study

SPECIAL CONDITION 16. The Permittee shall work towards the goals of achieving no discharges from sanitary sewer overflows or basement back-ups and ensuring that overflows or back-ups, when they do occur do not cause or contribute to violations of applicable standards or cause impairment in any adjacent receiving water. Overflows from sanitary sewers are expressly prohibited by this permit and by 35 Ill. Adm. Code 306.304. As part of the process to ultimately achieve compliance through the elimination of and mitigating the adverse impacts of any such overflows if they do occur, the Permittee shall (A) identify and report to IEPA all SSOs that do occur, and (B) update the existing Capacity, Management, Operations, and Maintenance (CMOM) plan at least annually and maintain it at the facility for review during Agency Field Operations Section inspections. The Permittee shall submit copies of the CMOM to the IEPA upon written request. The Permittee shall modify the Plan to incorporate any comments that it receives from IEPA and shall implement the modified plan as soon as possible. The Permittee should work as appropriate, in consultation with affected authorities at the local, county, and/or state level to develop the plan components involving third party notification of overflow events. The Permittee may be required to construct additional sewage transport and/or treatment facilities in future permits or other enforceable documents should the implemented CMOM plan indicate that the Permittee's facilities are not capable of conveying and treating the flow for which they are designed.

The CMOM plan shall include the following elements:

A. Measures and Activities:

1. A complete map and system inventory for the collection system owned and operated by the Permittee;
2. Organizational structure; budgeting; training of personnel; legal authorities; schedules for maintenance, sewer system cleaning, and preventative rehabilitation; checklists, and mechanisms to ensure that preventative maintenance is performed on equipment owned and operated by the Permittee;
3. Documentation of unplanned maintenance;
4. An assessment of the capacity of the collection and treatment system owned and operated by the Permittee at critical junctions and immediately upstream of locations where overflows and backups occur or are likely to occur; use flow monitoring and/or sewer hydraulic modeling, as necessary;
5. Identification and prioritization of structural deficiencies in the system owned and operated by the Permittee. Include preventative maintenance programs to prevent and/or eliminate collection system blockages from roots or grease, and prevent corrosion or negative effects of hydrogen sulfide which may be generated within collection system;
6. Operational control, including documented system control procedures, scheduled inspections and testing, list of scheduled frequency of cleaning (and televising as necessary) of sewers;
7. The Permittee shall develop and implement an Asset Management strategy to ensure the long-term sustainability of the collection system. Asset Management shall be used to assist the Permittee in making decisions on when it is most appropriate to repair, replace or rehabilitate particular assets and develop long-term funding strategies; and
8. Asset Management shall include but is not limited to the following elements:
 - a. Asset Inventory and State of the Asset;

NPDES Permit No. IL0021989

Special Conditions

- b. Level of Service;
 - c. Critical Asset Identification;
 - d. Life Cycle Cost; and
 - e. Long-Term Funding Strategy.
- B. Design and Performance Provisions:
1. Monitor the effectiveness of CMOM;
 2. Upgrade the elements of the CMOM plan as necessary; and
 3. Maintain a summary of CMOM activities.
- C. Overflow Response Plan:
1. Know where overflows and back-ups within the facilities owned and operated by the Permittee occur;
 2. Respond to each overflow or back-up to determine additional actions such as clean up; and
 3. Locations where basement back-ups and/or sanitary sewer overflows occur shall be evaluated as soon as practicable for excessive inflow/infiltration, obstructions or other causes of overflows or back-ups as set forth in the System Evaluation Plan.
 4. Identify the root cause of the overflow or basement backup, and document to files;
 5. Identify actions or remediation efforts to reduce risk of reoccurrence of these overflows or basement backups in the future, and document to files.
- D. System Evaluation Plan:
1. Summary of existing SSO and Excessive I/I areas in the system and sources of contribution;
 2. Evaluate plans to reduce I/I and eliminate SSOs;
 3. Evaluate the effectiveness and performance in efforts to reduce excessive I/I in the collection system;
 4. Special provisions for Pump Stations and force mains and other unique system components; and
 5. Construction plans and schedules for correction.
- E. Reporting and Monitoring Requirements:
1. Program for SSO detection and reporting; and
 2. Program for tracking and reporting basement back-ups, including general public complaints.
- F. Third Party Notice Plan:
1. Describes how, under various overflow scenarios, the public, as well as other entities, would be notified of overflows within the Permittee's system that may endanger public health, safety or welfare;
 2. Identifies overflows within the Permittee's system that would be reported, giving consideration to various types of events including events with potential widespread impacts;
 3. Identifies who shall receive the notification;
 4. Identifies the specific information that would be reported including actions that will be taken to respond to the overflow;
 5. Includes a description of the lines of communication; and
 6. Includes the identities and contact information of responsible POTW officials and local, county, and/or state level officials.

For additional information concerning USEPA CMOM guidance and Asset Management please refer to the following web site addresses:
http://www.epa.gov/npdes/pubs/cmom_guide_for_collection_systems.pdf and
http://water.epa.gov/type/watersheds/wastewater/upload/guide_smallsystems_assetmanagement_bestpractices.pdf

SPECIAL CONDITION 17. The Permittee shall reuse 1,800,000 gallons a month within the facility. In November of each year, the Permittee shall report the quantities discharged during the months of May through October and the amount diverted on the Discharge Monitoring Reports. The Permittee shall retain a state operating permit for the land application of wastewater effluent and shall be subject to the applicable requirements.

SPECIAL CONDITION 18. The Permittee shall notify the IEPA in writing of any operational deficiencies and corrective measures to be taken if the expanded treatment plant exceeds a monthly average concentration value of 10 mg/l of Total Nitrogen in the effluent. Correspondence shall be directed to:

Illinois Environmental Protection Agency
Bureau of Water
Compliance Assurance Section, Mail Code #19
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

Illinois Environmental Protection Agency
Bureau of Water
Springfield Field Office, Mail Code #10
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

SPECIAL CONDITION 19. The Permittee has undergone a Monitoring Reduction review and the influent and effluent sample frequency has been reduced for parameters due to sustained compliance. The IEPA may require that the influent and effluent sampling frequency for these parameters be increased without Public Notice. This provision does not limit EPA's authority to require additional monitoring, information or studies pursuant to Section 308 of the CWA.

SPECIAL CONDITION 20. An effluent limit of 0.5 mg/L Total Phosphorus 12-month rolling geometric mean (calculated monthly)

Special Conditions

(hereinafter Limit) will be applicable to the Permittee beginning January 1, 2030.

SPECIAL CONDITION 21. The Agency has determined that the Permittee's treatment plant effluent is located upstream of a waterbody or stream segment that has been determined to be at risk of eutrophication. This determination was made upon reviewing available information concerning the characteristics of the relevant waterbody/segment and the relevant facility (such as quantity of discharge flow and nutrient load relative to the stream flow).

A waterbody or segment is at risk of eutrophication if there is available information that plant, algal or cyanobacterial growth is causing or will cause violation of a water quality standard.

The Permittee shall develop, or be a part of a watershed group that develops, a Nutrient Assessment Reduction Plan (NARP) that will meet the following requirements:

- A. The NARP shall be developed and submitted to the Agency by December 31, 2024. This requirement can be accomplished by the Permittee, by participation in an existing watershed group or by creating a new group. The NARP shall be supported by data and sound scientific rationale.
- B. The Permittee shall cooperate with and work with other stakeholders in the watershed to determine the most cost-effective means to address the risk of eutrophication. If other stakeholders in the watershed will not cooperate in developing the NARP, the Permittee shall develop its own NARP for submittal to the Agency to comply with this condition.
- C. In determining the target levels of various parameters necessary to address the risk of eutrophication, the NARP shall either utilize the recommendations by the Nutrient Science Advisory Committee or develop its own watershed-specific target levels.
- D. The NARP shall identify phosphorus input reductions from point sources and non-point sources in addition to other measures necessary to remove the risk of eutrophication characteristics that will cause or may cause violation of a water quality standard. The NARP may determine, based on an assessment of relevant data, that the watershed does not have a risk of eutrophication related to phosphorus, in which case phosphorus input reductions or other measures would not be necessary. Alternatively, the NARP could determine that phosphorus input reductions from point sources are not necessary, or that phosphorus input reductions from both point and nonpoint sources are necessary, or that phosphorus input reductions are not necessary and that other measures, besides phosphorus input reductions, are necessary.
- E. The NARP shall include a schedule for the implementation of the phosphorus input reductions and other measures. The NARP schedule shall be implemented as soon as possible and shall identify specific timelines applicable to the permittee.
- F. The NARP can include provisions for water quality trading to address the phosphorus related risk of eutrophication characteristics in the watershed. Phosphorus/Nutrient trading cannot result in violations of water quality standards or applicable antidegradation requirements.
- G. The Permittee shall request modification of the permit within 90 days after the NARP has been completed to include necessary phosphorus input reductions identified within the NARP. The Agency will modify the permit if necessary.
- H. If the Permittee does not develop or assist in developing the NARP and such a NARP is developed for the watershed, the Permittee will become subject to effluent limitations necessary to address the risk of eutrophication. The Agency shall calculate these effluent limits by using the NARP and any applicable data. If no NARP has been developed, the effluent limits shall be determined for the Permittee on a case-by-case basis, so as to ensure that the Permittee's discharge will not cause or contribute to violations of the dissolved oxygen or narrative offensive condition water quality standards.

SPECIAL CONDITION 22. Mixing for ammonia was not granted for this discharge, since mixing is not necessary. Based on the past DMR data, it appears that the facility can meet the ammonia water quality standards in the effluent, without mixing. If mixing is determined to be needed, the permittee must demonstrate that the mixing zone requirements found at 35 Ill. Adm. Code 302.1025 (a) and (b) are met."

SPECIAL CONDITION 23. PFAS Testing and Reporting

1. PFAS Sample Frequency and Type of Sample.

<u>Sampling Point</u>	<u>Sample Frequency</u>	<u>Sample Type</u>	<u>Report</u>
Effluent	Quarterly*	Grab***	ng/L
Influent	Quarterly*	Grab***	ng/L
Biosolids	Semiannually**	Grab	µg/kg

*Quarterly sampling – Testing done during the first quarter (January – March) must be reported on the April Electronic Discharge Monitoring Report (NetDMR), testing done in the second quarter (April – June) must be reported on the July NetDMR, testing done in the third quarter (July – September) must be reported on the October NetDMR, and testing done in the fourth quarter (October – December) must be reported on the January NetDMR.

**Semiannually sampling – Testing done during the first half of each year (January through June) must be reported on the July NetDMR and sampling taken during the second half of each year (July through December) must be reported on the January NetDMR.

NPDES Permit No. IL0021989

Special Conditions

***If the permittee prefers to collect a composite sample instead of a grab sample, the composite sample shall be a manual composite consisting of a minimum of 4 separate grab samples that will be manually mixed at the lab for analysis. Composite samples shall not be collected using the typical automatic composite sampling equipment. All samples shall be collected during dry weather flow, during normal business hours.

Influent and Effluent test results must be reported in nanograms per liter (ng/L) as a daily maximum concentration Biosolids test results must be reported in micrograms per kilograms (ug/kg) as a daily maximum load.

Monitoring for Per- and polyfluoroalkyl Substances (PFAS) shall be performed using USEPA 3rd draft test method 1633 or subsequent draft test method. Upon USEPA's final approval and incorporation under 40 CFR 136, the approved method shall be used for PFAS testing.

The Minimum Level (ML) of Detection identified in paragraph 6) of this Special Condition is based on the USEPA's 3rd Draft Method 1633, dated December 2022. The permittee shall use these minimum levels of detection until they are replaced by subsequent draft methods, or a final method is defined under 40 CFR 136. At that time of update the permittee shall use the revised minimum level of detection values as part of this permit.

Following two years of quarterly sampling, the permittee may request a reduction in testing frequency, or an elimination of testing, by filing an NPDES permit modification request with the Agency. Quarterly sampling shall continue until such time as the Agency modifies the NPDES permit to either reduce or eliminate the quarterly sampling requirement.

Specific PFAS constituents that must be tested for, and reported on, are listed in the following table:

Target Analyte Name	Abbreviation	CAS Number	STORET	Minimum Level (ML) of Detection	
Perfluoroalkyl carboxylic acids				Aqueous (ng/L)	Solids (ng/g)
Perfluorobutanoic acid	PFBA	375-22-4	51522	2.0	0.8
Perfluoropentanoic acid	PFPeA	2706-90-3	51623	2.0	0.4
Perfluorohexanoic acid	PFHxA	307-24-4	51624	2.0	0.2
Perfluoroheptanoic acid	PFHpA	375-85-9	51625	2.0	0.2
Perfluorooctanoic acid	PFOA	335-67-1	51521	2.0	0.2
Perfluorononanoic acid	PFNA	375-95-1	51626	2.0	0.2
Perfluorodecanoic acid	PFDA	335-76-2	51627	2.0	0.2
Perfluoroundecanoic acid	PFUnA	2058-94-8	51628	2.0	0.2
Perfluorododecanoic acid	PFDaA	307-55-1	51629	2.0	0.2
Perfluorotridecanoic acid	PFTTrDA	72629-94-8	51630	2.0	0.2
Perfluorotetradecanoic acid	PFTeDA	376-06-7	51631	2.0	0.2
Perfluoroalkyl sulfonic acids					
Acid Forms					
Perfluorobutanesulfonic acid	PFBS	375-73-5	52602	2.0	0.2
Perfluoropentanesulfonic acid	PFPeS	2706-91-4	52610	2.0	0.2
Perfluorohexanesulfonic acid	PFHxS	355-46-4	52605	2.0	0.2
Perfluoroheptanesulfonic acid	PFHpS	375-92-8	52604	2.0	0.2
Perfluorooctanesulfonic acid	PFOS	1763-23-1	52606	2.0	0.2
Perfluorononanesulfonic acid	PFNS	68259-12-1	52611	2.0	0.2
Perfluorodecanesulfonic acid	PFDS	335-77-3	52603	2.0	0.2
Perfluorododecanesulfonic acid	PFDoS	79780-39-5	52632	2.0	0.2
Fluorotelomer sulfonic acids					
1H,1H, 2H, 2H-Perfluorohexane sulfonic acid	4:2FTS	757124-72-4	52605	5.0	0.8
1H,1H, 2H, 2H-Perfluorooctane sulfonic acid	6:2FTS	27619-97-2	62606	10	0.8
1H,1H, 2H, 2H-Perfluorodecane sulfonic acid	8:2FTS	39108-34-4	52603	10	0.8

NPDES Permit No. IL0021989

Special Conditions

Perfluorooctane sulfonamides					
Perfluorooctanesulfonamide	PFOSA	754-91-6	51525	2.0	0.2
N-methyl perfluorooctanesulfonamide	NMeFOSA	31506-32-8	52641	2.0	0.2
N-ethyl perfluorooctanesulfonamide	NEtFOSA	4151-50-2	52642	2.0	0.2
Perfluorooctane sulfonamidoacetic acids					
N-methyl perfluorooctanesulfonamidoacetic acid	NMeFOSAA	2355-31-9	51644	2.0	0.2
N-ethyl perfluorooctanesulfonamidoacetic acid	NEtFOSAA	2991-50-6	51643	2.0	0.2
Perfluorooctane sulfonamide ethanols					
N-methyl perfluorooctanesulfonamidoethanol	NMeFOSE	24448-09-7	51642	10	2
N-ethyl perfluorooctanesulfonamidoethanol	NEtFOSE	1691-99-2	51641	20	2
Per- and Polyfluoroether carboxylic acids					
Hexafluoropropylene oxide dimer acid	HFPO-DA	13252-13-6	52612	5.0	0.8
4,8-Dioxa-3H-perfluorononanoic acid	ADONA	919005-14-4	52636	5.0	0.8
Perfluoro-3-methoxypropanoic acid	PFMPA	377-73-1	PF002	2.0	0.4
Perfluoro-4-methoxybutanoic acid	PFMBA	863090-89-5	PF006	2.0	0.4
Nonafluoro-3,6-dioxaheptanoic acid	NFDHA	151772-58-6	PF007	5.0	0.4
Ether sulfonic acids					
9-Chlorohexadecafluoro-3-oxanonane-1-sulfonic acid	9Cl-PF3ONS	756426-58-1	PF003	5.0	0.8
11-Chloroeicosafluoro-3-oxaundecane-1-sulfonic acid	11Cl-PF3OUdS	763051-92-9	PF004	5.0	0.8
Perfluoro(2-ethoxyethane)sulfonic acid	PFEESA	113507-82-7	PF007	2.0	0.4
Fluorotelomer carboxylic acids					
3-Perfluoropropyl propanoic acid	3:3FTCA	356-02-5	PF001	10	1.0
2H,2H,3H,3H-Perfluorooctanoic acid	5:3FTCA	914637-49-3	PF007	20	5.0
3-Perfluoroheptyl propanoic acid	7:3FTCA	812-70-4	PF005	20	5.0

SPECIAL CONDITION 24. PFAS Reduction Program:

1) PFAS Inventory:

- a) The Permittee shall develop an inventory of those of facilities which may have the potential to contribute or discharge PFAS into the sanitary sewer system. At a minimum, facilities which fall under one or more of the following SIC (NAICS) codes must be considered for inclusion in this inventory:

1020 (212230), 1041 (212221), 1094 (212291), 1311 (211120), 2221 (313210), 2262 (313310), 2273 (314110), 2295 (313320), 2297 (313230), 2299 (313110), 2385 (314999), 2392 (314999), 2394 (314910), 2621 (322121), 2656 (322219), 2671 (322220), 2672 (322220), 2673 (322220), 2752 (323111), 2796 (323120), 2813 (325120), 2819 (211130, 325130, 325180), 2821 (325211), 2822 (325212), 2824 (325220), 2841 (325611), 2842 (325612), 2843 (325613), 2844 (325611), 2851 (325510), 2869 (325110, 325193, 325199), 2899 (325199, 325510, 325998), 2911 (324110), 2992 (324191), 3011 (326211), 3081 (326113), 3082 (326121), 3083 (326130), 3089 (326121), 3111 (316110), 3231 (323215, 327310), 3471 (332813), 3479 (332812), 3497 (332999), 3577 (334418), 3589 (333318), 3629 (335999), 3643 (335931), 3651 (334310), 3663 (334220), 3672 (334412), 3674 (334413), 3679 (334419), 3841 (333249), 3861 (333316), 4581 (488119), 4953 (562211, 562212, 562213, 562219), 5169 (424690), 5719 (442291), 7217 (561740), 7641 (811420), 9711 (928110).

- b) Examples of other activities that may not have specific SIC codes, but have the potential to contribute or discharge PFAS into the sewer system, and therefore must also be included when developing the inventory list are:
- Landfill leachate,
 - Firefighting training facilities,
 - Any other activities that the permittee determines are known or expected sources of PFAS.

NPDES Permit No. IL0021989

Special Conditions

- c) The following information must be included for each facility that is included in the inventory:
- i) The facility name and address,
 - ii) List of SIC code(s,) or other reasons, which require the facility to be placed on the inventory list,
 - iii) Identification of wastewater discharges from the industrial facility which may have the potential to contribute or discharge PFAS into the sanitary sewer system,
 - iv) Actual or estimated monthly average flow rate in gallons per day (gpd) of wastewater being discharged to the sanitary sewer system by the facility for the previous year.
- d) The Permittee must submit an initial inventory report within 12 months of the permit effective date. Subsequent annual updated reports of the inventory list will be due 12 months from the previous report due date for the term of the permit.

Information on the initial and subsequent updated inventory reports must include:

- i) The name, address, and NPDES permit number of the Permittee,
- ii) The name and address of each facility on the inventory list,
- iii) List of SIC code(s,) or other reasons, for each facility which resulted in the facility to be placed on the inventory list,
- iv) Identification of wastewater discharges at each facility which may have the potential to contribute or discharge PFAS into the sanitary sewer system,
- v) Actual or estimated monthly average flow rate in gallons per day (gpd) of wastewater being discharged to the sewer system during the previous year for each facility on the inventory list.

Annual updated reports should identify only those sites currently discharging wastewater to the sanitary sewer.

2) PFAS Reduction Initiative:

- a) Within 24 months from the effective date of the permit the Permittee shall develop and implement a PFAS reduction initiative. The reduction initiative must include PFAS loading reduction plans for facilities identified in the inventory under paragraph 1) of this Special Condition.
- b) The PFAS loading reduction plans referred to above must include, for facilities identified in the inventory, the following Best Management Practices (BMPs):
 - i) Evaluation of the potential for the facility to use products containing PFAS or have knowledge or suspect wastewater being discharged to the sewer system to contain PFAS.
 - ii) Evaluation of Pollution prevention/source reduction opportunities which may include:
 - (1) Product elimination or substitution when a reasonable alternative to using PFAS is available in the industrial process,
 - (2) Accidental discharge minimization by optimizing operations and good housekeeping practices,
 - (3) Equipment decontamination or replacement (such as in metal finishing facilities) where PFAS products have historically been used to prevent discharge of legacy PFAS following the implementation of product substitution.
 - iii) Identification of the measures being taken to reduce PFAS loading from the facility, and any available information, including facility wastewater testing for PFAS, and/or the loading reduction achieved.
- c) PFAS loading reduction plans must be reevaluated and updated on an annual basis. The updated plans must identify any changes made since the previous plan was submitted.
- d) The Permittee is required to submit a PFAS reduction report annually to the Illinois Environmental Protection Agency at the addresses identified under paragraph 3) of this permit with the first report due 36 months from the permit effective date. Subsequent annual reports shall be due 12 months following the previous report's due date.

PFAS reduction reports must include the following information:

- i) The name, address, and NPDES permit number of the Permittee,
- ii) The name and address for each facility on the most current inventory list,
- iii) The current PFAS loading reduction plans for each facility on the PFAS inventory list. Updated plans should include all changes made since the previous plan was submitted.

3) The Permittee shall submit the reports identified under paragraphs 1) and 2) of this Special Condition electronically or in writing to one of the following addresses:

- a) EPA.PrmtSpecCondtns@Illinois.gov
- b) Illinois Environmental Protection Agency

NPDES Permit No. IL0021989

Special Conditions

Bureau of Water
Compliance Assurance Section
Mail Code #19
1021 North Grand Avenue East
Post Office Box 19276
Springfield, Illinois 62794-9276

SPECIAL CONDITION 25. The Permittee shall sample for cyanide (available) 2 Days/Month for six (6) months beginning three (3) months from the effective date of this Permit. The samples shall be a composite sample and reported on Discharge Monitoring Report (DMR) electronic forms as a monthly average and daily maximum. If the data demonstrates that the Permittee does have a reasonable potential to exceed the water quality standard based on the data collected for cyanide the permit may be modified to include water quality limits.