

NPDES Permit No. IL0021881

Notice No. SKT:25020301.skt

Public Notice Beginning Date: March 11, 2025

Public Notice Ending Date: April 10, 2025

National Pollutant Discharge Elimination System (NPDES)
Permit Program

PUBLIC NOTICE/FACT SHEET
of
Draft Reissued NPDES Permit to Discharge into Waters of the State

Public Notice/Fact Sheet Issued By:

Illinois EPA
Division of Water Pollution Control
Permit Section
2520 West Iles Avenue
Post Office Box 19276
Springfield, Illinois 62794-9276
217/782-0610

Name and Address of Permittee:

City of Belleville
101 South Illinois Street
Belleville, Illinois 62220

Name and Address of Facility:

Belleville - Area 2 STP
6400 Route 15
Belleville, Illinois 62220
(St. Clair County)

The Illinois Environmental Protection Agency (IEPA) has made a tentative determination to issue a NPDES Permit to discharge into the waters of the state and has prepared a draft Permit and associated fact sheet for the above named Permittee. The Public Notice period will begin and end on the dates indicated in the heading of this Public Notice/Fact Sheet. All comments on the draft Permit and requests for hearing must be received by the IEPA by U.S. Mail, carrier mail or hand delivered by the Public Notice Ending Date. Interested persons are invited to submit written comments on the draft Permit to the IEPA at the above address. Commentors shall provide his or her name and address and the nature of the issues proposed to be raised and the evidence proposed to be presented with regards to those issues. Commentors may include a request for public hearing. Persons submitting comments and/or requests for public hearing shall also send a copy of such comments or requests to the Permit applicant. The NPDES Permit and notice numbers must appear on each comment page.

The application, engineer's review notes including load limit calculations, Public Notice/Fact Sheet, draft Permit, comments received, and other documents are available for inspection and may be copied at the IEPA between 9:30 a.m. and 3:30 p.m. Monday through Friday when scheduled by the interested person.

If written comments or requests indicate a significant degree of public interest in the draft Permit, the permitting authority may, at its discretion, hold a public hearing. Public notice will be given 45 days before any public hearing. Response to comments will be provided when the final Permit is issued. For further information, please call Surinder Tandon at 217/782-0610.

The following water quality and effluent standards and limitations were applied to the discharge:

Title 35: Environmental Protection, Subtitle C: Water Pollution, Chapter I: Pollution Control Board and the Clean Water Act were applied in determining the applicable standards, limitations and conditions contained in the draft Permit.

The applicant is engaged in treating excess flow for the City of Belleville Area 2 STP service area.

The length of the Permit is approximately 5 years.

The main discharge number is 001 - Excess Flow Outfall. The seven day once in ten year low flow (7Q10) of the receiving stream, unnamed tributary of Gartside Creek is 0 cfs.

Dry weather flow from City of Belleville Area 2 service area is pumped to the Stockey Township Main STP (IL0025232). Flows in excess of 1200 gpm will be treated and discharged from this facility. Treatment consists of chlorine disinfection.


On January 8, 1996 the IEPA issued Permit No. 1996-AB-5707 which authorized the elimination of the Belleville STP #2 treatment plant and its replacement with a lift station and holding tank. The lift station is equipped with two dry weather pumps with a capacity of 350 gpm and two wet weather pumps that have a capacity of 1200 gpm. During dry weather, the dry weather pumps the wastewater to the Skokie Township Main STP (IL0025232) which has a maximum design flow of 4.74 MGD. The City and the Township have an intergovernmental agreement regarding the arrangement. During rainfall events, once capacity in the wet well is reached, wastewater overflows the weir wall into the stormwater area and the water is pumped to the holding tank. The holding tank is sized for 0.50 MGD. Once the tank is filled, storm water overflows to an un-named tributary to Gartside Creek. The wet weather pump station capacity is 1200 gpm.

This Reissued Permit does not increase the facility's DAF, DMF, concentration limits, and/or load limits.

Application is made for the existing discharge(s) which is located in St. Clair County, Illinois. The following information identifies the discharge point, receiving stream and stream classifications:

| <u>Discharge Number</u> | <u>Receiving Stream</u> | <u>Latitude</u> | <u>Longitude</u> | <u>Stream Classification</u> | <u>Integrity Rating</u> |
|-------------------------|-------------------------------------|-------------------|------------------|------------------------------|-------------------------|
| 001 | Unnamed tributary of Gartside Creek | 38° 32' 00" North | 90° 02' 00" West | General Use | Not Rated |

To assist you further in identifying the location of the discharge(s) please see the map below:

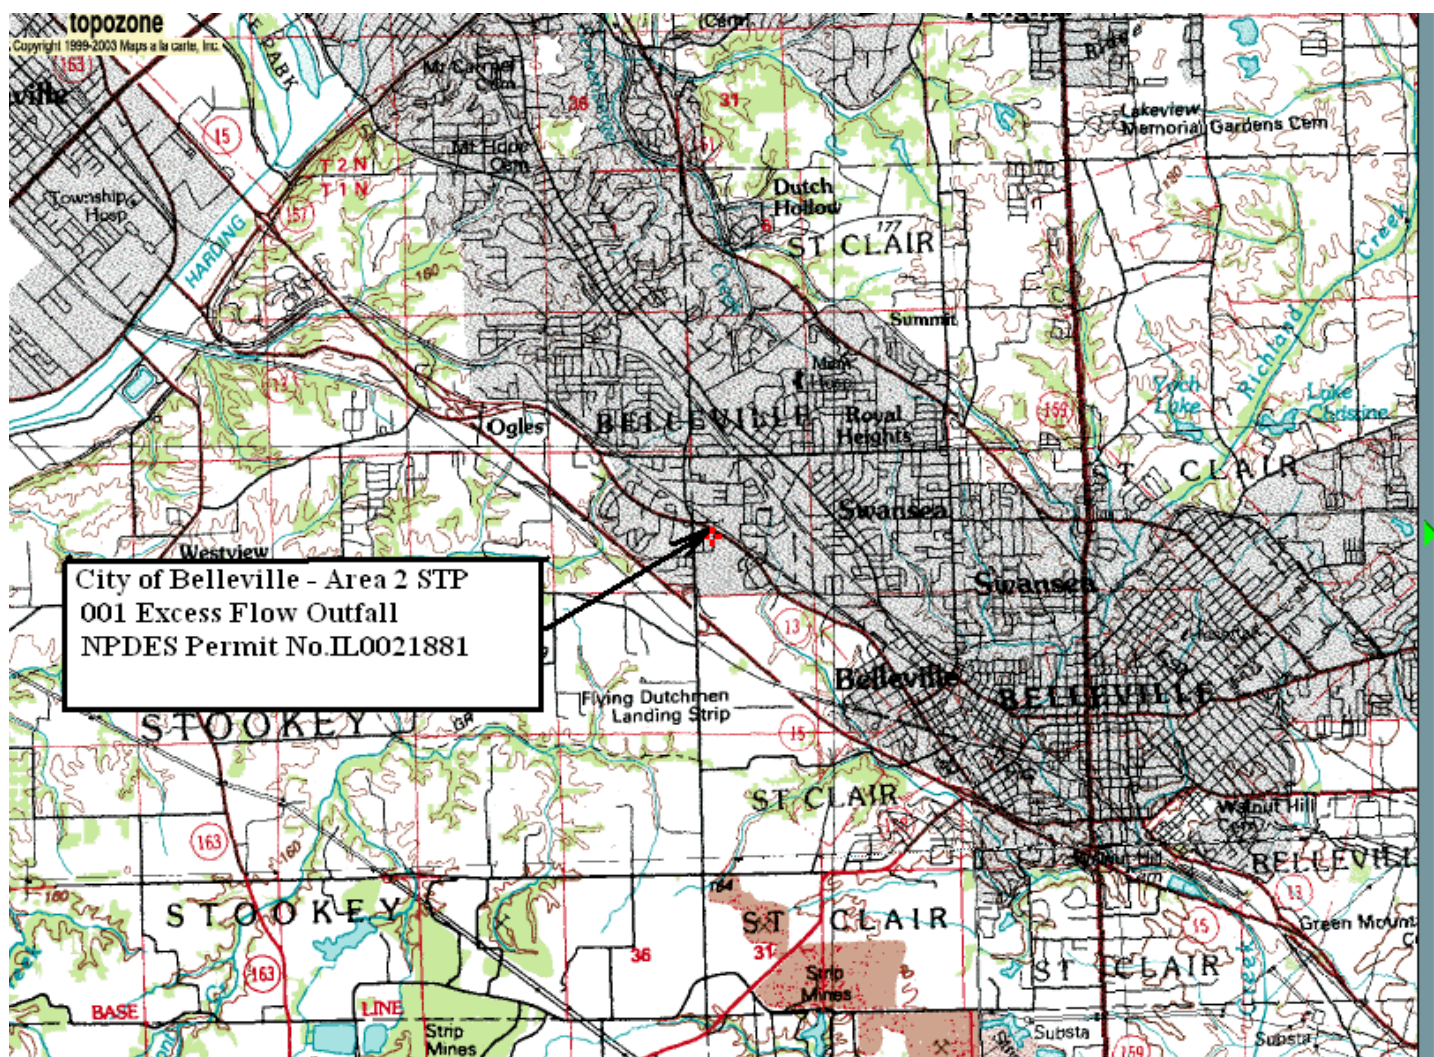

The unnamed tributary of Gartside Creek, tributary to Waterbody Segment, JMAAB-D1, receiving the discharge from outfall(s) 001 is not listed on the 2024 Illinois Integrated Water Quality Report and Section 303(d) List since it has not been assessed.

This Permit contains an authorization to treat and discharge excess flow as follows:

Discharge Number(s) and Name(s): 001 Excess Flow Outfall (flow in excess of 1200 gpm)

| <u>Parameter</u> | <u>CONCENTRATION LIMITS (mg/L)</u> | | <u>Regulation</u> |
|-------------------------|--|-----------------------|-------------------|
| | <u>Monthly Average</u> | <u>Weekly Average</u> | |
| BOD ₅ * | 30 | 45 | 40 CFR 133.102 |
| Suspended Solids* | 30 | 45 | 40 CFR 133.102 |
| Fecal Coliform | Daily Maximum Shall Not Exceed 400 per 100 mL | | 35 IAC 304.121 |
| pH | Shall be in the range of 6 to 9 Standard Units | | 35 IAC 304.125 |
| Chlorine Residual | 0.75 | | 35 IAC 302.208 |
| Ammonia Nitrogen (as N) | Monitor Only | | 35 IAC 309.146 |

*The 30-day average percent removal shall not be less than 85 percent.

This draft Permit also contains the following requirements as special conditions:

1. Reopening of this Permit to include different final effluent limitations.
2. Operation of the facility by or under the supervision of a certified operator.
3. Submission of the operational data in a specified form and at a required frequency at any time during the effective term of this Permit.
4. More frequent monitoring requirement without Public Notice in the event of operational, maintenance or other problems resulting in possible effluent deterioration.
5. Prohibition against causing or contributing to violations of water quality standards.
6. Recording the monitoring results on Discharge Monitoring Report Forms using one such form for each outfall each month and submitting the forms to IEPA each month.
7. The provisions of 40 CFR Section 122.41(m) & (n) are incorporated herein by reference.
8. Effluent sampling point location.
9. Controlling the sources of infiltration and inflow into the sewer system.
10. Submission of annual fiscal data.
11. Reopening of this Permit to include revised effluent limitations based on a Total Maximum Daily Load (TMDL).
12. Re-issued Capacity, Management, Operations and Maintenance (CMOM) plan.

NPDES Permit No. IL0021881

Illinois Environmental Protection Agency

Division of Water Pollution Control

2520 West Iles Avenue

Post Office Box 19276

Springfield, Illinois 62794-9276

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM

Reissued (NPDES) Permit

Expiration Date:

Issue Date:

Effective Date:

Name and Address of Permittee:

City of Belleville
101 South Illinois Street
Belleville, Illinois 62220

Facility Name and Address:

Belleville - Area 2 STP
6400 Route 15
Belleville, Illinois 62220
(St. Clair County)

Receiving Waters: Unnamed tributary of Gartside Creek

In compliance with the provisions of the Illinois Environmental Protection Act, Title 35 of the Ill. Adm. Code, Subtitle C, Chapter I, and the Clean Water Act (CWA), the above-named Permittee is hereby authorized to discharge at the above location to the above-named receiving stream in accordance with the Effluent Limitations, Monitoring, and Reporting requirements; Special Conditions and Attachment H Standard Conditions attached herein.

Permittee is not authorized to discharge after the above expiration date. In order to receive authorization to discharge beyond the expiration date, the Permittee shall submit the proper application as required by the Illinois Environmental Protection Agency (IEPA) not later than 180 days prior to the expiration date.

Brant D. Fleming, P.E.
Manager, Municipal Unit, Permit Section
Division of Water Pollution Control

BDF:SKT:25020301.skt

NPDES Permit No. IL0021881

Effluent Limitations, Monitoring, and Reporting

FINAL

This Permit contains an authorization to treat and discharge excess flow as follows:

Discharge Number(s) and Name(s): 001 Excess Flow Outfall (flow in excess of 1200 gpm)

These flow facilities shall not be utilized until the main treatment facility is receiving its maximum design flow* (flow in excess of 1200 gpm).

From the effective date of this Permit until the expiration date, the effluent of the above discharge(s) shall be monitored and limited at all times as follows:

| <u>Parameter</u> | <u>CONCENTRATION LIMITS (mg/L)</u> | | <u>Sample Frequency</u> | <u>Sample Type</u> |
|-------------------------|--|-----------------------|-------------------------|--------------------|
| | <u>Monthly Average</u> | <u>Weekly Average</u> | | |
| Total Flow (MGD) | See Below | | Daily When Discharging | Continuous |
| BOD ₅ ** | 30 | 45 | Daily When Discharging | Grab |
| Suspended Solids** | 30 | 45 | Daily When Discharging | Grab |
| Fecal Coliform | Daily Maximum Shall Not Exceed 400 per 100 mL | | Daily When Discharging | Grab |
| pH | Shall be in the range of 6 to 9 Standard Units | | Daily When Discharging | Grab |
| Chlorine Residual | 0.75 | | Daily When Discharging | Grab |
| Ammonia Nitrogen (as N) | Monitor Only | | Daily When Discharging | Grab |

*An explanation shall be provided in the comment section of the DMR should these facilities be used when the main treatment facility is not receiving Design Maximum Flow (DMF). The explanation shall identify the reasons the main facility is at a diminished treatment capacity. Additionally, the Permittee shall comply with the provisions of Special Condition 7.

**BOD₅ and Suspended Solids (85% removal required): In accordance with 40 CFR 133, the 30-day average percent removal shall not be less than 85 percent. The percent removal need not be reported to the IEPA on DMRs but influent and effluent data must be available, as required elsewhere in this Permit, for IEPA inspection and review. For measuring compliance with this requirement, 5 mg/L shall be added to the effluent CBOD₅ concentration to determine the effluent BOD₅ concentration. Percent removal is a percentage expression of the removal efficiency across a treatment plant for a given pollutant parameter, as determined from the 30-day average values of the raw wastewater influent concentrations to the facility and the 30-day average values of the effluent pollutant concentrations for a given time period. .

Total flow in million gallons shall be reported on the Discharge Monitoring Report (DMR) in the quantity maximum column.

Report the number of days of discharge in the comments section of the DMR.

Fecal Coliform shall be reported on the DMR as daily maximum.

Chlorine Residual shall be reported on the DMR as monthly average.

pH shall be reported on the DMR as a minimum and a maximum.

BOD₅ and Suspended solids shall be reported on the DMR as a monthly and weekly average concentration.

Ammonia Nitrogen shall be reported on the DMR as a daily maximum value.

NPDES Permit No. IL0021881

Influent Monitoring, and Reporting

The influent to the plant shall be monitored as follows:

| <u>Parameter</u> | <u>Sample Frequency</u> | <u>Sample Type</u> |
|------------------|-------------------------|--------------------|
| Flow (MGD) | Continuous | |
| BOD ₅ | Daily When Discharging | Composite |
| Suspended Solids | Daily When Discharging | Composite |

Influent samples shall be taken at a point representative of the influent.

Flow (MGD) shall be reported on the Discharge Monitoring Report (DMR) as monthly average and daily maximum.

BOD₅ and Suspended Solids shall be reported on the DMR as a monthly average concentration.

Special Conditions

SPECIAL CONDITION 1. This Permit may be modified to include different final effluent limitations or requirements which are consistent with applicable laws, regulations, or judicial orders. The IEPA will public notice the permit modification.

SPECIAL CONDITION 2. The use or operation of this facility shall be by or under the supervision of a Certified Class 4 operator.

SPECIAL CONDITION 3. The IEPA may request in writing submittal of operational information in a specified form and at a required frequency at any time during the effective period of this Permit.

SPECIAL CONDITION 4. The IEPA may request more frequent monitoring by permit modification pursuant to 40 CFR § 122.63 and Without Public Notice in the event of operational, maintenance or other problems resulting in possible effluent deterioration.

SPECIAL CONDITION 5. The effluent, alone or in combination with other sources, shall not cause a violation of any applicable water quality standard outlined in 35 Ill. Adm. Code 302.

SPECIAL CONDITION 6. The Permittee shall record monitoring results on Discharge Monitoring Report (DMR) electronic forms using one such form for each outfall each month.

In the event that an outfall does not discharge during a monthly reporting period, the DMR Form shall be submitted with no discharge indicated.

The Permittee is required to submit electronic DMRs (NetDMRs) instead of mailing paper DMRs to the IEPA unless a waiver has been granted by the Agency. More information, including registration information for the NetDMR program, can be obtained on the IEPA website, <https://www2.illinois.gov/epa/topics/water-quality/surface-water/netdmr/pages/quick-answer-guide.aspx>.

The completed Discharge Monitoring Report forms shall be submitted to IEPA no later than the 25th day of the following month, unless otherwise specified by the permitting authority.

Permittees that have been granted a waiver shall mail Discharge Monitoring Reports with an original signature to the IEPA at the following address:

Illinois Environmental Protection Agency
Division of Water Pollution Control
Attention: Compliance Assurance Section, Mail Code # 19
2520 West Iles Avenue
Post Office Box 19276
Springfield, Illinois 62794-9276

SPECIAL CONDITION 7. The provisions of 40 CFR Section 122.41(m) & (n) are incorporated herein by reference.

SPECIAL CONDITION 8. Samples taken in compliance with the effluent monitoring requirements shall be taken at a point representative of the discharge, but prior to entry into the receiving stream.

SPECIAL CONDITION 9. This Permit may be modified to include requirements for the Permittee on a continuing basis to evaluate and detail its efforts to effectively control sources of infiltration and inflow into the sewer system and to submit reports to the IEPA if necessary.

SPECIAL CONDITION 10. During January of each year the Permittee shall submit annual fiscal data regarding sewerage system operations to the Illinois Environmental Protection Agency/Division of Water Pollution Control/Compliance Assurance Section. The Permittee may use any fiscal year period provided the period ends within twelve (12) months of the submission date.

Submission shall be on forms provided by IEPA titled "Fiscal Report Form For NPDES Permittees".

SPECIAL CONDITION 11. This Permit may be modified to include alternative or additional final effluent limitations pursuant to an approved Total Maximum Daily Load (TMDL) Study or upon completion of an alternate Water Quality Study.

SPECIAL CONDITION 12 The Permittee shall work towards the goals of achieving no discharges from sanitary sewer overflows or basement back-ups and ensuring that overflows or back-ups, when they do occur do not cause or contribute to violations of applicable standards or cause impairment in any adjacent receiving water. Overflows from sanitary sewers are expressly prohibited by this permit and by Ill. Adm. Code 306.304. As part of the process to ultimately achieve compliance through the elimination of and mitigating the adverse impacts of any such overflows if they do occur, the Permittee shall (A) identify and report to IEPA all SSOs that do occur, and (B) update the existing Capacity, Management, Operations, and Maintenance (CMOM) plan at least annually and maintain it at the facility for review during Agency Field Operations Section inspections. The Permittee shall submit copies of the CMOM to the IEPA upon written request. The Permittee shall modify the Plan to incorporate any comments that it receives from IEPA and shall implement

Special Conditions

the modified plan as soon as possible. The Permittee should work as appropriate, in consultation with affected authorities at the local, county, and/or state level to develop the plan components involving third party notification of overflow events. The Permittee may be required to construct additional sewage transport and/or treatment facilities in future permits or other enforceable documents should the implemented CMOM plan indicate that the Permittee's facilities are not capable of conveying and treating the flow for which they are designed.

The CMOM plan shall include the following elements:

A. Measures and Activities:

1. A complete map and system inventory for the collection system owned and operated by the Permittee;
2. Organizational structure; budgeting; training of personnel; legal authorities; schedules for maintenance, sewer system cleaning, and preventative rehabilitation; checklists, and mechanisms to ensure that preventative maintenance is performed on equipment owned and operated by the Permittee;
3. Documentation of unplanned maintenance;
4. An assessment of the capacity of the collection and treatment system owned and operated by the Permittee at critical junctions and immediately upstream of locations where overflows and backups occur or are likely to occur; use flow monitoring and/or sewer hydraulic modeling, as necessary;
5. Identification and prioritization of structural deficiencies in the system owned and operated by the Permittee. Include preventative maintenance programs to prevent and/or eliminate collection system blockages from roots or grease, and prevent corrosion or negative effects of hydrogen sulfide which may be generated within collection system;
6. Operational control, including documented system control procedures, scheduled inspections and testing, list of scheduled frequency of cleaning (and televising as necessary) of sewers;
7. The Permittee shall develop and implement an Asset Management strategy to ensure the long-term sustainability of the collection system. Asset Management shall be used to assist the Permittee in making decisions on when it is most appropriate to repair, replace or rehabilitate particular assets and develop long-term funding strategies; and
8. Asset Management shall include but is not limited to the following elements:
 - a. Asset Inventory and State of the Asset;
 - b. Level of Service;
 - c. Critical Asset Identification;
 - d. Life Cycle Cost; and
 - e. Long-Term Funding Strategy.

B. Design and Performance Provisions:

1. Monitor the effectiveness of CMOM;
2. Upgrade the elements of the CMOM plan as necessary; and
3. Maintain a summary of CMOM activities.

C. Overflow Response Plan:

1. Know where overflows and back-ups within the facilities owned and operated by the Permittee occur;
2. Respond to each overflow or back-up to determine additional actions such as clean up; and
3. Locations where basement back-ups and/or sanitary sewer overflows occur shall be evaluated as soon as practicable for excessive inflow/infiltration, obstructions or other causes of overflows or back-ups as set forth in the System Evaluation Plan.
4. Identify the root cause of the overflow or basement backup, and document to files;
5. Identify actions or remediation efforts to reduce risk of reoccurrence of these overflows or basement backups in the future, and document to files.

D. System Evaluation Plan:

1. Summary of existing SSO and Excessive I/I areas in the system and sources of contribution;
2. Evaluate plans to reduce I/I and eliminate SSOs;
3. Evaluate the effectiveness and performance in efforts to reduce excessive I/I in the collection system;
4. Special provisions for Pump Stations and force mains and other unique system components; and
5. Construction plans and schedules for correction.

E. Reporting and Monitoring Requirements:

1. Program for SSO detection and reporting; and
2. Program for tracking and reporting basement back-ups, including general public complaints.

F. Third Party Notice Plan:

Special Conditions

1. Describes how, under various overflow scenarios, the public, as well as other entities, would be notified of overflows within the Permittee's system that may endanger public health, safety or welfare;
2. Identifies overflows within the Permittee's system that would be reported, giving consideration to various types of events including events with potential widespread impacts;
3. Identifies who shall receive the notification;
4. Identifies the specific information that would be reported including actions that will be taken to respond to the overflow;
5. Includes a description of the lines of communication; and
6. Includes the identities and contact information of responsible POTW officials and local, county, and/or state level officials.

For additional information concerning USEPA CMOM guidance and Asset Management please refer to the following web site addresses. http://www.epa.gov/npdes/pubs/cmom_guide_for_collection_systems.pdf and http://water.epa.gov/type/watersheds/wastewater/upload/guide_smallsystems_assetmanagement_bestpractices.pdf



ILLINOIS ENVIRONMENTAL PROTECTION AGENCY

2520 WEST ILES AVENUE, P.O. BOX 19276, SPRINGFIELD, ILLINOIS 62794-9276 • (217) 782-3397

JB PRITZKER, GOVERNOR

JAMES JENNINGS, ACTING DIRECTOR

217/782-0610

City of Belleville
101 South Illinois Street
Belleville, Illinois 62220

Re: City of Belleville
Belleville - Area 2 STP
NPDES Permit No. IL0021881
Bureau ID: W1630100004
Draft Permit

Applicant:

Attached to this letter is a copy of the draft Permit, Public Notice/Fact Sheet for your discharge. The Agency proposes to issue the NPDES Permit for your discharge as shown in the draft Permit.

Fifteen days from the date of this letter, the Agency proposes to distribute the attached Public Notice/Fact Sheet statewide. If you have objections to the content of the Public Notice/Fact Sheet, a written statement must be received by the Agency at the indicated address, attention: NPDES PN Clerk within 10 days.

The Agency will receive comments regarding the Permit for a period of 30 days after the Public Notice is issued. If you wish to comment or object to any of the terms and conditions of the Permit, you must state the objections in writing prior to the end of the public notice. The Agency may or may not change the Permit based on comments received from you or the public.

If you should have questions or comments regarding the above, please contact Surinder Tandon at 217/782-0610.

Sincerely,

Brant D. Fleming, P.E.
Manager, Municipal Unit, Permit Section
Division of Water Pollution Control

BDF:SKT:25020301.skt

Attachments: Draft Permit, Public Notice/Fact Sheet

cc: Records Unit



ILLINOIS ENVIRONMENTAL PROTECTION AGENCY

2520 WEST ILES AVENUE, P.O. BOX 19276, SPRINGFIELD, ILLINOIS 62794-9276 • (217) 782-3397

JB PRITZKER, GOVERNOR

JAMES JENNINGS, ACTING DIRECTOR

217/782-0610

U.S. Army Corps of Engineers
St. Louis District
Attn: Regulatory Branch
Corps of Engineers
1222 Spruce Street
St. Louis, Missouri 63103

Re: City of Belleville
Belleville - Area 2 STP
NPDES Permit No. IL0021881
Bureau ID: W1630100004
Request for Corps of Engineers Comment

To Whom It May Concern:

Attached please find a copy of the Public Notice/Fact Sheet for the subject discharge. Please review for determination of the impact of this discharge on navigation and anchorage. If no written reply is received at the indicated address, attention: NPDES PN Clerk within 15 days of the date of this request, the Agency will assume the Corps of Engineers has no objection to the proposed discharge.

Sincerely,

Brant D. Fleming, P.E.
Manager, Municipal Unit, Permit Section
Division of Water Pollution Control

BDF:SKT:25020301.skt

Attachment: Public Notice/Fact Sheet

cc: Records Unit



ILLINOIS ENVIRONMENTAL PROTECTION AGENCY

2520 WEST ILES AVENUE, P.O. BOX 19276, SPRINGFIELD, ILLINOIS 62794-9276 • (217) 782-3397
JB PRITZKER, GOVERNOR **JAMES JENNINGS**, ACTING DIRECTOR

MEMORANDUM

DATE:

TO: Manager, DWPC/FOS, Collinsville Region

FROM: Brant D. Fleming, Manager, Municipal Unit

SUBJECT: City of Belleville
Belleville - Area 2 STP
NPDES Permit No. IL0021881
Bureau ID: W1630100004
Draft Permit, Public Notice/Fact Sheet

Please review the attached copy of the subject documents, and notify the Northern Municipal Unit if you take exception to the limitations, sampling frequency, sample type or other requirements therein.

If no response is received within fifteen (15) days from the date of this memorandum, we will assume that you concur in the issuance of the Public Notice.

If you have any questions, please contact Surinder Tandon at 217/782-0610.

Thank you for your cooperation.

BDF:SKT:25020301.skt

cc: Records



ILLINOIS ENVIRONMENTAL PROTECTION AGENCY

2520 WEST ILES AVENUE, P.O. BOX 19276, SPRINGFIELD, ILLINOIS 62794-9276 • (217) 782-3397

JB PRITZKER, GOVERNOR

JAMES JENNINGS, ACTING DIRECTOR

217/782-0610

Municipal Clerk
City of Belleville
101 South Illinois Street
Belleville, Illinois 62220

Re: City of Belleville
Belleville - Area 2 STP
NPDES Permit No. IL0021881
Bureau ID: W1630100004
Public Notice of Permit

Municipal Clerk:

In accordance with the requirements of the Illinois Pollution Control Board regulations of 35 Ill. Adm. Code 309.109(a)(2)(A), the attached National Pollutant Discharge Elimination System Public Notice is sent to a municipality in the vicinity of the applicant. The Agency understands that the applicant may not be associated with the municipality to which it is sent.

Please post the attached National Pollutant Discharge Elimination System Public Notice for a period of 30 days. In addition, please complete and return the enclosed postcard indicating the date of posting. Should you choose not to post the attached notice, please indicate so on the postcard and return.

Thank you for your cooperation.

Sincerely,

Brant D. Fleming, P.E.
Manager, Municipal Unit, Permit Section
Division of Water Pollution Control

BDF:SKT:25020301.skt

Attachments: Public Notice/Fact Sheet, Post Card

cc: Records Unit



ILLINOIS ENVIRONMENTAL PROTECTION AGENCY

2520 WEST ILES AVENUE, P.O. BOX 19276, SPRINGFIELD, ILLINOIS 62794-9276 • (217) 782-3397

JB PRITZKER, GOVERNOR

JAMES JENNINGS, ACTING DIRECTOR

217/782-0610

City of Belleville
101 South Illinois Street
Belleville, Illinois 62220

Re: City of Belleville
Belleville - Area 2 STP
NPDES Permit No. IL0021881
Bureau ID: W1630100004
Public Notice Permit

Applicant:

Please post the attached Public Notice for the subject discharge for at least a period of thirty days from the date on the Notice in a conspicuous place on your premises.

We have enclosed a copy of the draft NPDES permit on which this official Public Notice is based. If you wish to comment on the draft permit, please do so within 30 days of the Public Notice date. If there are any questions, please contact Surinder Tandon at 217/782-0610 or the address listed above.

Thank you for your cooperation.

Sincerely,

Brant D. Fleming, P.E.
Manager, Municipal Unit, Permit Section
Division of Water Pollution Control

BDF:SKT:25020301.skt

Attachments: Draft Permit, Public Notice/Fact Sheet

cc: Records Unit
Collinsville Region
SWIMRPC



ILLINOIS ENVIRONMENTAL PROTECTION AGENCY

2520 WEST ILES AVENUE, P.O. BOX 19276, SPRINGFIELD, ILLINOIS 62794-9276 • (217) 782-3397

JB PRITZKER, GOVERNOR

JAMES JENNINGS, ACTING DIRECTOR

217/782-0610

U.S. Fish & Wildlife Service
Rock Island Field Office
1511 47th Avenue
Moline, IL 61265

Re: City of Belleville
Belleville - Area 2 STP
NPDES Permit No. IL0021881
Bureau ID: W1630100004

To Whom It May Concern:

In accordance with 40 CFR 124.10, we hereby submit a copy of the Public Notice/Fact Sheet for the above discharger. If no written reply is received at the indicated address, attention: NPDES PN Clerk within 30 days of the date of this request, the Agency will assume that the U.S. Fish and Wildlife Service has no objection to the proposed discharge.

Sincerely,

Brant D. Fleming, P.E.
Manager, Municipal Unit, Permit Section
Division of Water Pollution Control

BDF:SKT:25020301.skt

Attachment: Public Notice/Fact Sheet

cc: Records

Unit



ILLINOIS ENVIRONMENTAL PROTECTION AGENCY

2520 WEST ILES AVENUE, P.O. BOX 19276, SPRINGFIELD, ILLINOIS 62794-9276 • (217) 782-3397

JB PRITZKER, GOVERNOR

JAMES JENNINGS, ACTING DIRECTOR

217/782-0610

City of Belleville
101 South Illinois Street
Belleville, Illinois 62220

Re: City of Belleville
Belleville - Area 2 STP
NPDES Permit No. IL0021881
Bureau ID: W1630100004
Final Permit

Gentlemen:

Attached is the final NPDES Permit for your discharge. The Permit as issued covers discharge limitations, monitoring, and reporting requirements. Failure to meet any portion of the Permit could result in civil and/or criminal penalties. The Illinois Environmental Protection Agency is ready and willing to assist you in interpreting any of the conditions of the Permit as they relate specifically to your discharge.

Pursuant to the Final NPDES Electronic Reporting Rule, all permittees must report DMRs electronically unless a waiver has been granted by the Agency. The Agency utilizes NetDMR, a web based application, which allows the submittal of electronic Discharge Monitoring Reports instead of paper Discharge Monitoring Reports (DMRs). More information regarding NetDMR can be found on the Agency website, <https://www2.illinois.gov/epa/topics/water-quality/surface-water/netdmr/pages/quick-answer-guide>. If your facility has received a waiver from the NetDMR program, a supply of preprinted paper DMR Forms will be sent to your facility. Additional information and instructions will accompany the preprinted DMRs. Please see the attachment regarding the electronic reporting rule.

The attached Permit is effective as of the date indicated on the first page of the Permit. Until the effective date of any re-issued Permit, the limitations and conditions of the previously-issued Permit remain in full effect. You have the right to appeal any condition of the Permit to the Illinois Pollution Control Board within a 35 day period following the issuance date.

Should you have questions concerning the Permit, please contact Surinder Tandon at 217/782-0610.

Sincerely,

Brant D. Fleming, P.E.
Manager, Municipal unit, Permit Section
Division of Water Pollution Control

BDF:SKT:25020301.skt

Attachment: Final Permit

cc: Records
Compliance Assurance Section
Collinsville Region
Billing
SWIMRPC
USEPA